



# 15<sup>TH</sup> EDITION

THIS DOCUMENT IS  
UPDATED CONTINUOUSLY  
AND AVAILABLE AT MOPIA.CA

## MOPIA COMPLIANCE GUIDE

OZONE DEPLETING SUBSTANCES  
& OTHER HALOCARBONS

GUIDANCE FOR HVAC, REFRIGERATION,  
A/C, AND FIRE SUPPRESSION SECTORS



## MOPIA'S MANITOBA COMPLIANCE GUIDE

AN INNOVATIVE MANITOBA  
NON-GOVERNMENT ORGANIZATION (NGO)  
IN COLLABORATION WITH THE PRIVATE SECTOR,  
MANITOBA GOVERNMENT AND OTHER LEADING  
STAKEHOLDERS

### READY FOR THE CHALLENGE !

**MOPIA** is here to assist you in your transition of phasing-out, eliminating or properly managing the stewardship of various Ozone Depleting Substances (ODSs) and halocarbons including such synthetic gases as CFCs, HCFCs, HFCs, HFOs, halons and other substitutes or alternatives in your possession at your workplace, in the course of your employment, business and throughout the environment.

We encourage you to contact **MOPIA** if you require information on Manitoba's unique stratospheric ozone and climate protection program. If you need assistance or clarification on some of the information in this guide, a speaker at one of your events, information on ozone depletion, sun awareness, climate change or industry practices.

Tell us how can we improve our program or future compliance guides. Let us know what's missing or suggest what should be added. **MOPIA** is looking to make this guide and future info pieces as useful and comprehensive as possible.

### MOPIA

845 Henderson Highway, Winnipeg, Manitoba R2W 5J3

Phone: 204.338.2222 • Toll Free: 888.667.4203

Fax: 204.338.0810

E-mail: [mopia@mopia.ca](mailto:mopia@mopia.ca)

Website: [www.mopia.ca](http://www.mopia.ca)

You are welcome to duplicate, share or quote information within **MOPIA's** Compliance Guide. However, some material is sourced from other organizations and so where appropriate, we ask that you provide a reference or an appropriate credit.



# STRIVING TO BE ACCURATE (Disclaimer)

**MOPIA's** Compliance Guide was prepared for your information and to help you comply with the **Manitoba Ozone Depleting Substances and Other Halocarbons Regulation 103/94**. However, this Compliance Guide and the federal Code of Practice do not replace any Act or Regulation and have no legal force themselves. The appropriate legislation must be referred for all purposes of interpretation and application of the law. The responsibility falls on the users of this guide to ensure that they comply with all applicable legislation. **MOPIA** takes no responsibility for any errors or omissions.

This guide provides general information and a summary of the **Manitoba Ozone Depleting Substances Act** and **the Regulation** only. Always refer to the actual legislative text.

The complete provisions dealing with the use of regulated refrigerants (and halons) are contained in the *Ozone Depleting Substances Act* (Chapter 080) and the accompanying *Ozone Depleting Substances and Other Halocarbons Regulation 103/94*. Copies of the legislation and information on other ozone-depleting substances not covered may be obtained from **MOPIA** or the Government of Manitoba website:  
[web2.gov.mb.ca/laws/index.php](http://web2.gov.mb.ca/laws/index.php)

Note that the certificate course is in no way to be construed as certification or a license of competency to repair / service refrigeration and air conditioning or fire suppression equipment. The trained service technician certification demonstrates accreditation in understanding provincial legislation (**Manitoba Ozone Depleting Substances Act and Regulation**) and environmental awareness.

# CONTENTS

|                                                               |    |
|---------------------------------------------------------------|----|
| Introduction . . . . .                                        | 8  |
| A Note from MOPIA's Executive Director . . . . .              | 13 |
| What are ODSs? . . . . .                                      | 16 |
| Universal Ratification . . . . .                              | 19 |
| Alternatives / Replacements . . . . .                         | 24 |
| The Manitoba ODS Act . . . . .                                | 25 |
| Penalties Under the Act . . . . .                             | 26 |
| Manitoba's Regulation . . . . .                               | 27 |
| Key Responsibilities for Service Technicians . . . . .        | 28 |
| Key Responsibilities for Companies . . . . .                  | 31 |
| Foams . . . . .                                               | 41 |
| The Automotive Sector . . . . .                               | 42 |
| CFC Chiller Phase Out . . . . .                               | 44 |
| Halon Requirements . . . . .                                  | 45 |
| Mandatory Record Keeping . . . . .                            | 46 |
| Federal Legislation . . . . .                                 | 47 |
| White Goods / Appliances . . . . .                            | 48 |
| Common Questions & Answers . . . . .                          | 49 |
| Appendices . . . . .                                          | 58 |
| Ozone in the Atmosphere . . . . .                             | 58 |
| Climate Change Dynamics . . . . .                             | 59 |
| Ozone Depleting & Global Warming Potential . . . . .          | 60 |
| Federal Halocarbons Regulations . . . . .                     | 61 |
| Canadian Phase-Out . . . . .                                  | 61 |
| Thermostat Mercury Recovery Program . . . . .                 | 64 |
| Record Data Sheet . . . . .                                   | 65 |
| Refrigerant Disposal . . . . .                                | 66 |
| Approved Leak Testing . . . . .                               | 67 |
| Certification Training . . . . .                              | 71 |
| Product Recovery / Stewardship . . . . .                      | 72 |
| Enforcement & Penalties . . . . .                             | 72 |
| Industry & Public Outreach . . . . .                          | 73 |
| Regulated Products . . . . .                                  | 75 |
| MOPIA's Team . . . . .                                        | 78 |
| Environmental Resources / Links . . . . .                     | 80 |
| Environment Officers' Contact Information . . . . .           | 81 |
| Extended Producer Responsibility & Circular Economy . . . . . | 82 |



**September 16**  
**annually**

[www.un.org/en/observances/ozone-day](http://www.un.org/en/observances/ozone-day)



*Kent Cielen, Jon Kublianski, the Honourable Mike Moyes, Mark Miller and Will Thrift at the Manitoba Legislature, May 2025*



*MOPIA's booth at a Montreal Protocol Conference in Bangkok*



*MOPIA at the Montreal Protocol Conference with Dr. Stephen Andersen and Marco Buoni (Centro Galileo)*



*MOPIA's booth at a recent Montreal Protocol Meeting*



*MOPIA in Dauphin for the 2025 Outreach Session*



*MOPIA with Ozone Officers of Carribean Nations*





MOPIA's booth at a Meeting of the Parties to the Montreal Protocol




Kirk Esau and Marc Chassart at AtmoSphere America in Washington DC

**Claire Perry** · 1st Climate Campaign Leader at Environment  
1w · Edited · 3

Day 4 of the Montreal Protocol's #OEWMG47 meeting and we're publishing an important new report on HFCs outlining the "Persistent Problems" with HFCs - fourth generation fluorocarbon gases being promoted as climate and environmentally friendly alternatives to HFCs. Unfortunately, they are anything but, with many classed as **PFAS** forever chemicals while problems associated with patents, high costs and availability mean that they in no way respond to the obligations of countries according to the text of the Montreal Protocol treaty to ensure that "the best available environmentally safe substitutes" are expeditiously transferred to developing countries "under fair and favourable conditions" (Article 10A, Montreal Protocol, the ...more

7 comments · 9 reposts

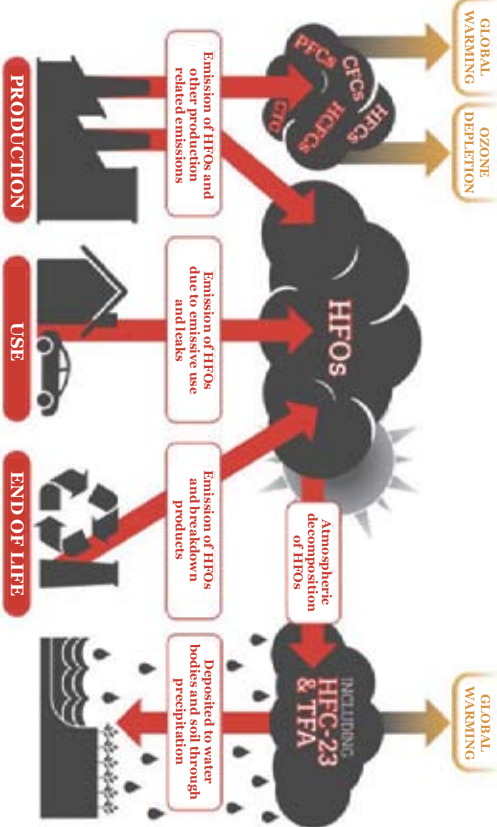



# INTRODUCTION

**MOPIA's** Regulatory Compliance Guide was developed originally in 1993 and updated several times including most recently in 2026. It is specifically designed to assist those in the refrigeration & air conditioning fields (HVAC/R), as those sectors include the most stakeholders and regulatory requirements. However, this guide may also be useful for those using “other” regulated substances used as fire extinguishing agents (halons), foams, solvents and propellants. It is also handy for the general public for use as an information tool regarding regulated products and industries' regulatory responsibilities.

## *MOPIA: Successful and Self-Sustaining*

The **Manitoba Ozone Protection Industry Association Incorporated (MOPIA)** was created in October 1993 by a group of committed individuals from various associations (industry and environmental), companies, groups and government institutions to address ozone and climate challenges.

**MOPIA** is a not-for-profit, non-governmental organization that has been appointed under Manitoba's Regulation 103/94 to administer components of the Regulation to provide certification training, receive ODS records, leak reports, certificate renewals, public and industry support and/or information. **MOPIA** will endeavor to provide information and the necessary infrastructure for industry and the public to comply with Manitoba's Regulation and innovative atmosphere and climate protection programs.

Since 1994, **MOPIA** has succeeded through the efforts of volunteers from across the province representing stakeholders including refrigeration & air conditioning, halons (fire extinguishing agents), sterilants, solvents and foams, environment & union

groups, educational institutions and government liaisons. **MOPIA** has an elected Executive, Board of Directors and a full-time Executive Director and staff. The association is a non-exclusionary coalition of representatives that welcomes direct participation through a nominal annual membership fee. We are non-partisan and have no direct political affiliation.

## *Active Outreach*

**MOPIA** participates in various local, provincial, national and international outreach initiatives. Each spring and summer, **MOPIA** hosts a series of provincial compliance awareness sessions for stakeholders.

**MOPIA** is active on the national and international level. We were an endorsing agency to the International Conference on Climate Change and CFC Alternatives held during the 1990s. **MOPIA** also attends most United Nations Ozone Secretariat Montreal Protocol Meetings (MOP) and sessions pertinent to our stakeholders hosted by Environment and Climate Change Canada (ECCC) and others such as Shecco, RMC, and UN agencies.

**MOPIA** continues to host open and transparent Annual General Meetings to ensure our stakeholders are informed and involved with our initiatives.

**MOPIA** has also collaborated with UNEP DTIE and the global community by hosting international capacity building study tours to Manitoba. We continue to liaise and dialogue with innovators and developing nations around the world.

**MOPIA** has continued to respond and progress to the needs of our stakeholders. New and innovative approaches to outreach, including consumer, public and industry awareness continue to be initiated.

Continuing industry compliance awareness promotions are developed to inform the media and public of the importance of the efforts of our stakeholders efforts and those of **MOPIA**.

Let us know if you have any suggestions to make Manitoba's atmosphere protection program among the best in the World!

## MOPIA'S MISSION

*To provide information and assistance (the leadership, administrative and technical support) to all stakeholders in an effort to uniformly phase-out and eliminate the use of ozone-depleting substances in the Province of Manitoba.*



*Don Thomson, John Kubilanski, Mark Miller and Kent Cielen, at 40th OEWG Vienna (2018)*



*MOPIA's 28th AGM held online Earth Day, April 22, 2022*



*Michael Blackey, Ms. Samira Korban-de Gobert (editor-OzoNews) & Mark Miller*



*Meghan Skordenski, Michael Blackey, Stephen O. Andersen & Mark Miller in Geneva at the 24th MOP (2012)*

## ACTION IN / BY MANITOBA

**MOPIA** is a self sustaining, environmental stewardship program model, unique to the world.

- Manitoba is the first province to mandate halon certification and permits
- First province to mandate certification training for technicians
- Best stakeholder engagement and awareness program
- Actively engaged with the international community on tackling ozone depletion and climate change
- Supporting capacity building with nations around the world, including Bahrain, Jamaica, Burkino-Faso, Uruguay, Fiji, China, Senegal, and others.

See: [www.gov.mb.ca/sd/](http://www.gov.mb.ca/sd/)



*Minister of Environment and Climate Change, The Honourable Mike Moyes*

*The Manitoba Government is continuing to consult with Manitobans on how best to tackle the many challenges of climate change*

## AWARD WINNING



- **INNOVATIVE**
- **EXPERIENCED**
- **RESOURCEFUL**



**MOPIA** was awarded the Provincial Sustainability Award by former Premier Gary Filmon in the 1990's. **MOPIA** went on to be nominated for the US EPA Stratospheric Award and others.

*Pictured are former Chairs Bob Stark, Dawn Turner and Mark Miller (Executive Director).*



*John Kubilanski, Mr. Shende, & Mark Miller in Dubai at the 27th MOP (2015)*



*Mr. Chasserot (shecco.com), Mark Miller & Brent Hoare (greencooling.com) in Brussels at ATMOSphere Conference*



*Meghan Skorodenski & Mark Miller at the 25th MOP in Bangkok (2013)*



*Mark Miller (MOPIA), Mr. Jim Curlin (UNEP), and Don Thomson (HTOC)*

## A NOTE FROM MOPIA'S EXECUTIVE DIRECTOR



I have seen a lot of positive achievements made through the implementation of The Montreal Protocol over the past 30+ years! I have been fortunate to be a small part of this success by working with stakeholders locally and around the world. A difference has been made due to local ingenuity and innovation, unique regulatory approaches and by sharing expertise around the earth.

More progress must be made to continue efforts to tackle climate change. Many refrigerants are among the most potent greenhouse gases and for that alone, our collective efforts must continue.

**MOPIA** is 7,000+ technicians strong! With among the strongest penalties for non compliance around the globe, our initiative is effective, a model for others to learn from and strives to address the evolving challenges of the times. Manitoba is a leader on many of these fronts. Ozone and climate protection strategies must continue to be a serious priority for all levels of government. From the emergence and embracing of clean energy and technologies, our world will be inevitably challenged with changing political and corporate dynamics. Our world in 2030 will be much different than today, with many more climate refugees, possible food and water shortages, pressures of geopolitical forces and international terrorism.

In Canada, both the federal and provincial governments are striving to implement new regulatory controls to restrict the use of HFCs (potent GHGs) with the passing of the Kigali Amendment (28th Meeting of the Parties, 2016). This is a significant step forward to protect the climate system. It will also mean the introduction of new refrigerants, and other gases, technologies and methods to handle these alternatives.

**MOPIA** will strive hard to keep aware and on the leading edge for our stakeholders – knowledgeable about emerging technology and regulatory strategies via our broad international liaisons. Our training will continue to be second to none and we aim to achieve many more successes. **MOPIA** has done many innovative projects and with your input we will continue to be among the most efficient, informative and creative NGOs in the world for the benefit of our stakeholders and the earth's environment!

My best regards,

  
Mark Miller



# MOPIA'S (ExCOM) EXECUTIVE COMMITTEE



*John Kubilanski*  
*Chair of the Board of Directors*



*Kent A. Cielen*  
*Vice President, Treasurer*



*Will Thrift*  
*Secretary*



*Meaghan Skorodenski*  
*Past Chair*



*Kirk Esau*  
*Member-at-large*

# MOPIA'S BOARD OF DIRECTORS

Members of **MOPIA's** Board are professionals with a wealth of expertise, ranging from positions as educators, manufacturers, managers, service technicians, administrators, and senior government officials. Their knowledge and breadth of experience fosters **MOPIA's** unique leadership role. You too may qualify to become a board member. Contact **MOPIA** to learn how.



*Laverne Dalglish*



*Janice Braga*



*Donald Baker*



*Chad Bisko*



*Nyron Sankar*



*Botho Kramer*  
*Honorary Member*



*Rt. Hon. Ed Schreyer*  
*Honorary Member*

# WHAT ARE ODSs?

## *ODSs also include Halocarbons (HFCs)*

Ozone-depleting substances (ODSs) may commonly include air conditioning & refrigerant gases, halons, cleaning solvents, foam cushioning and insulation products, fumigants and sterilants. ODSs are also used in a variety of other applications such as an additive to make another substance or other products. In some instances, classes of ODSs have been banned for use. An example of this is Class 1 ODS used as an aerosol product carrier and in food containers.

Refrigeration and air conditioning systems are closed loops. This means that the refrigerant is contained within the sealed system of the unit. However, if the refrigerant escapes, this substance (gas) may ascend 15 – 40 kilometres above the earth and reaches through the ozone layer (nature's protective umbrella). At this point, the ODS molecule is broken down by the ultraviolet radiation from the sun. This occurs since the ozone layer is no longer able to protect the CFC or HCFC molecule from the full impact of the sun's ultraviolet radiation. Furthermore, this causes the chlorine atom to break off and start destroying the ozone. Each chlorine atom can destroy up to 100,000 ozone molecules before being washed out of the sky sometimes with rain. Scientists believe that it may take between 40-100 years for the atmosphere to thoroughly cleanse itself of chlorine containing chemicals.

Chlorofluorocarbons (CFCs) are extremely stable synthetic chemical compounds that have existed since the early 1930's. They were first developed as refrigerants for refrigerators and air conditioners.

In later years, CFCs became a popular blowing agent in the manufacture of foams, for such things as construction materials, drinking cups and furniture cushions. Other uses for CFCs were found in chlorinated cleaning solvents used to degrease metals or clean electrical circuit boards. Aerosol sprays and hospital sterilization applications also used CFC products.

Hydrochlorofluorocarbons (HCFCs) are less stable, not as damaging to the ozone layer and therefore more environmentally friendly than CFCs. Their use as a refrigerant should be viewed as a short term alternative and they should be looked upon as a bridging compound only.

HFCs (Hydrofluorocarbons) are also regulated and controlled substances in Manitoba. They do not contribute to ozone depletion but do have global warming characteristics and as such must be handled in the same safe manner as earlier generation refrigerants including CFCs and HCFCs. The Kigali Agreement of The Montreal Protocol now includes HFCs which will mandate their eventual phase-out of production and use by nations. Canada is already proposing use restrictions. At present, a new generation of substances (HFOs, a.k.a. hydrofluoroolefins) is appearing within the marketplace and these are not currently regulated but we recommend they be handled responsibly as they may become regulated and its always best to recovery and reuse than emit to the atmosphere.

Halons are chemicals that are used primarily for fire protection in aviation and by the military. They contain a chemical called bromine, which destroys the ozone layer. In fact, the potential of halons for destruction of the ozone layer is much greater than that of the most common CFCs.

# NATURAL REFRIGERANTS

*Natural refrigerants are a variety of gases that are typically less harmful to the environment than HFOs, HCFCs and HFCs. They have little global warming potential (GWP). They include carbon dioxide, ammonia and hydrocarbons (propane / butane).*

*Check out these sites for more information:*

[www.refnat4life.eu](http://www.refnat4life.eu)

[www.hydrocarbons21.com](http://www.hydrocarbons21.com)

[www.ausref.org.au](http://www.ausref.org.au)

[www.r744.com](http://www.r744.com)

## NATURAL REFRIGERANTS TRAINING IN MANITOBA

**MOPIA** is working with the UK Institute of Refrigeration and Centro Studi Galileo to offer natural refrigerant training in Canada. This is under development and should be available soon. Check **MOPIA's** website for the latest on how to enroll.



MOPIA is developing training options on natural refrigerants including hydrocarbons, R290 and others.

# UNIVERSAL RATIFICATION

## ACTION TO PROTECT THE OZONE LAYER

### The Montreal Protocol

**The Montreal Protocol** is the world's most successful environmental treaty to address policies and control substances that cause harm to the environment and human health. This was initiated in response to the growing scientific consensus that ODSs and halons would ultimately deplete the ozone layer. In 1981, the United Nations Environment Program (UNEP) began negotiations to develop multilateral protection of the stratospheric ozone layer. In March 1985, these negotiations resulted in the Vienna Convention for the Protection of the Ozone Layer. The Convention provided a framework for international cooperation in research, environmental monitoring and information exchange.

Back in September 1987, 24 nations, including the United States, Canada, Japan, the Soviet Union, the European Community (EC) and country members of the EC, signed The Montreal Protocol on Substances that Deplete the Ozone Layer. The Montreal Protocol entered into force on January 1, 1989. The Protocol also contains the requirement of technical and scientific assessments, to be undertaken at least every four years. Today, **197** nations, all UN-recognized countries in the world, have ratified The Montreal Protocol.

Shortly after the 1987 Protocol was negotiated, new scientific evidence conclusively linked CFCs to depletion of the ozone layer and confirmed that depletion had already occurred. Consequently, many countries called for further actions to protect the ozone layer by expanding and strengthening the original control provisions of The Montreal Protocol.

There have been successive amendments to The Montreal Protocol since its inception, and these can all be seen at: [www.ozone.unep.org](http://www.ozone.unep.org)

**MOPIA** has been an active participant in many Montreal Protocol meetings. These have been useful in learning about emerging technologies, regulatory approaches and dialogue with senior policy and environmental specialists.



See all Montreal Protocol text and amendments at:

<https://ozone.unep.org/treaties/montreal-protocol/amendments>



*MOPIA presented to a UNDP Latin America Webinar (June 2021) on End of Life ODS Management.  
Seen here is Mark Miller during the live webinar.*



*Luc Philippot, Kyle Reenders, Nicole Salchert and Mark Miller at MARR Conference in Winnipeg, November 2021.  
[www.marrmb.com](http://www.marrmb.com)*

## Kigali Agreement - HFC Phasedown

Parties to The Montreal Protocol agreed to amend the protocol at their 28<sup>th</sup> meeting in Rwanda (2016).

The Kigali Agreement is expected to reduce the manufacture and use of HFCs by up to 85% from their respective baselines by 2045. This reduction is expected to mitigate global temperature rise by 0.5 Celsius by 2100.

There is a global thrust to control HFCs, given their high global warming potential (GWP). Canada, along with many other nations, is taking a leadership role to control and reduce the reliance on HFCs. Environment and Climate Change Canada is proposing to regulate HFCs in Canada in various ODS sectors as soon as 2018. These will be potentially controlled under the Canadian Environmental Protection Act. Please refer to the actual text for more information.

For details visit:

<https://ozone.unep.org/kigali-amendment-implementation-policies>

## Control of Ozone Depleting Substances in Manitoba

In Manitoba, the control and use of ODSs is governed by the **Manitoba Ozone Depleting Substances and Other Halocarbons Act and Regulation**. In addition, the Government of Canada (Environment and Climate Change Canada) has Regulations dealing with the import, export, manufacture, use and sale of numerous ODSs. Other Canadian provinces also have separate Regulations governing ODSs and their substitutes. For the transportation of an ODS, provincial and/or federal legislation relating to the transportation of dangerous goods apply. Contact Transport Canada. In addition, certain associations (i.e. Canadian Standards Association, Underwriters Laboratory) have the responsibility to approve proper equipment (recovery



units, tanks, weights or scales). It should be noted that other government departments may have policies or Regulations governing ODSs and their substitutes or alternatives. Today, it is known that the use of various originally controlled substances have been reduced or entirely eliminated. These include most CFCs and halons.

Manitoba was the first province to implement mandatory certification training in Canada back in 1992. To date, some 14,000+ technicians have participated in the training that provided information to individuals about Regulation responsibilities and environmental awareness. It is not a trade license.

## Manitoba's Leadership Role

Manitoba also initiated the most innovative and successful model for stakeholder participation through the creation of **MOPIA**. In fact, **MOPIA** is being recognized widely as a practical and cost-effective model to facilitate compliance with government Regulations. **MOPIA** has a dynamic collaboration & consultation approach that encourages the most directly affected and knowledgeable to participate.

Manitoba's initiative is in harmony with the National Action Plan for the Recovery, Recycling and Reclamation of Chlorofluorocarbons. This was developed by the Federal and Provincial Governments to support Canada's commitments under "The Montreal Protocol". Manitoba's initiative is also consistent with *The Environmental Code of Practice for the Elimination of Fluorocarbon Emissions from Refrigeration and Air Conditioning Systems* (2015) adopted by Environment and Climate Change Canada. The prescribed timetables and sections in the act and the Regulation are a result of direct and extensive consultation with industry and other stakeholders.

Since January 1996, no new CFCs have been manufactured or imported in Canada. This means if there are CFC containing products to be repaired after that date, only recycled and reclaimed refrigerants will be available, and only for white goods as a refill ban is in effect for all other equipment. Therefore, we must conserve and prepare for the new ODS technologies. To this end, we should practice the following four R's:



**Reuse**  
**Recycle**  
**Recover**  
**Reclaim**

## Refrigerant Stewardship & Destruction of Surplus and/or Contaminated Refrigerants

Many wholesalers of refrigerants across Canada are part of a national initiative to received back used, cocktailed or surplus refrigerants from the stationary A/C and HVAC sectors. These refrigerants are then sent to RMC (Toronto) for processing and possible final destruction at plants designated to carry out this work (located in Alberta, Illinois and Texas).



**REFRIGERANT  
MANAGEMENT  
CANADA**

For more information, visit:

[www.refrigerantmanagement.ca](http://www.refrigerantmanagement.ca)

**Note** that the mobile and white goods sectors are not necessarily partners in the national refrigerant responsible care program.

Refrigerants from these sectors need to be disposed of safely and according to any environmental Regulations.

## ALTERNATIVES AND/OR REPLACEMENTS

Globally, the manufacture of class 1 CFCs has been eliminated, and the use and production of HCFCs continue to be reduced. In Manitoba, alternative refrigerants and ODS substitutes have become widely available. These primarily include HFCs, HFOs, ammonia, carbon dioxide and hydrocarbons. Recognized alternatives are published periodically by the U.S. Environmental Protection Agency (EPA) under their Significant New Alternatives Policy Program (SNAP). **MOPIA** does not endorse the use of any particular product or company. We encourage the use of energy-efficient, safe and environmentally friendly products.

Check with Original Equipment Manufacturers (OEMs) on their use specifications, insurance agencies on their stipulations (i.e. MPI) and their position/policy on the use of a product/gas and the various standard organizations including the Fire Commissioner, Canadian Standards Association, American Society of Heating, Refrigerating and Air-Conditioning Engineers, Transport Canada and others.

**MOPIA** encourages individuals to investigate and source alternative/substitute substances, taking note that certain substances have global warming potential (GWP) and/or may have health exposure limits for humans. Always read a substances Material Safety Data Sheet (MSDS) prior to use. Your local wholesaler or product agent is probably the best source for information.

**NOTE:** “Drop-in” replacements should be used cautiously (according to manufacturer specifications where available), and must not be added to a system if a different refrigerant is in the system. This must be properly recovered first. See **MOPIA’s** “Don’t D.I.Y.” poster online (page 73).

## THE MANITOBA ODS ACT

### THE OZONE-DEPLETING SUBSTANCES ACT (highlights)

**The Ozone Depleting Substances Act** (C.C.S.M. c.080) was given Royal Assent on March 8, 1990 and was proclaimed into force on July 1, 1992.

The Act acknowledges that the escape of ozone-depleting substances is harmful to public health and the natural environment by destroying ozone in the upper atmosphere.

The objective of the Act is to reduce and eventually eliminate the release of ozone-depleting substances into the atmosphere. The Act applies to substances that are designated as “ozone-depleting substances” within the Act itself or by the Regulation. Specific requirements are defined by the Regulations under the authority of this Act.

### Enforcement of the Act and the Regulation

Environment officers employed by **Manitoba Environment and Climate Change** are responsible for enforcement of the Act and Regulation, **not MOPIA personnel**. Any tips of abuse, misuse or actions contravening the Regulation may be reported to **Manitoba Environment and Climate Change** (204.945.7100, or [ods@gov.mb.ca](mailto:ods@gov.mb.ca)) for follow-up and / or investigation.

### Who to Contact in the Province

See page 77 for Government Contact Information, or visit: [www.gov.mb.ca/sd/](http://www.gov.mb.ca/sd/)

# PENALTIES UNDER THE ACT

## Offences and Penalties Section 8 (Act)

Persons or companies found in non-compliance with any provisions of the Regulation are liable to prosecution. It should be noted that Manitoba has among the highest notarized fines in the Act among all Parties to The Montreal Protocol.

Non-compliance under The Act allows for penalties of up to \$50,000 and/or 6 months in prison for individuals and \$500,000 for companies on a first offence.

## Offences and Penalties: Corporations Section 8 (Act)

In the case of a second or subsequent offence, to a fine not exceeding \$1,000,000, and for each day or part of a day that the offence continues after the day in respect of which the corporation is first charged with the offence, the corporation is liable to a fine not exceeding \$10,000.

## Other Penalties Section 8 (Act)

3. A judge may, in addition to a fine or other penalty under subsection (1) or (2), require a convicted person
  - a. to pay, as an additional fine, compensation for damages or to make restitution to a person who suffers loss or damage as a consequence of the commission of the offence, in such amount as the judge considers appropriate;
  - b. to pay, as an additional fine, an amount that represents the monetary benefit that is acquired by, or accrues to, the convicted person as a result of the commission of the offence

# MANITOBA'S REGULATION



The **Manitoba Ozone Depleting Substances and Other Halocarbons Regulation 103/94** (the ODS Regulation) came into effect on May 27, 1994. It provides requirements specified in the Act. In broad terms, the Regulation further defines the Act by providing details of handling regulated products.

## PROCESS FOR CHANGE

Since **MOPIA's** inception in 1993, **MOPIA** has been working proactively with representatives from both provincial and federal governments and our stakeholders to ensure our Regulation is current and relevant. **MOPIA** continues to keep engaged and attune to various regulatory strategies and new technologies in other locations, including outside North America.

Stakeholder comments are always encouraged to ensure a fair and level playing field for those affected by the regulatory framework. **MOPIA** has been hosting outreach and program awareness sessions across Manitoba. These events have assisted us to directly understand each region's unique needs and help consolidate ideas for potential (future) regulatory amendment recommendations.

Outreach sessions are held typically on an annual basis during the spring and summer. Watch **MOPIA's** website for details.

## Administrative Assistance

In 1994, the Manitoba Government appointed **MOPIA** to assist in delivering components of the Regulation. **MOPIA** works with those with a direct interest, to assist industry and the public, and move towards reducing & eliminating ODS consumption in Manitoba.

# KEY RESPONSIBILITIES FOR SERVICE TECHNICIANS

**MOPIA** has chosen to highlight selected regulatory responsibilities under Manitoba's Regulation 103/94 in this Compliance Guide. This guide does not include or highlight all regulatory responsibilities. You should navigate the entire Regulation to ensure you have a complete understanding of your requirements. Please review the following and consult the actual text if necessary to best ensure you understand what is legally required in the handling of regulated products.

## 1) Annual Renewal of Technician Certification

All service technicians must renew their certification annually by June 1<sup>st</sup> of each year through **MOPIA**. This may be done with payment of the annual fee in-person at **MOPIA**, by return mail, fax, over the phone, or online at [www.mopia.ca](http://www.mopia.ca) (by credit card).

**MOPIA** sends renewal reminders to all 7,000+ technicians one month in advance of the June 1<sup>st</sup> due date via mail and in the future we plan to via email to reduce our environmental footprint.

## 2) Record Data Sheets

Technicians & companies must mail, fax or email copies of their record data sheets once per year by February 1<sup>st</sup> to **MOPIA**. The records should document the use of regulated substances for the period January 1<sup>st</sup> to December 31<sup>st</sup> of the previous year. Even if you have not used any regulated refrigerant or halon during the year, we need to record this within our database. Be sure to let **MOPIA** know your name and Certification Number or you may be "flagged" for possible investigation for not submitting records.

## 3) Reporting of All Leaks (Intentional or not) over 22 lbs / 10 kgs

The technician working on a system containing a refrigerant gas (or halon) who discovers a leak must report the leak, both in their annual services records, and, it exceeds 22 lbs., to **Manitoba Environment, and Climate Change** immediately (same day of the incident or discovery).

For those that do not comply, charges may be served by an Environment Officer. A one-page leak report form (as shown below) must be completed and faxed in to **Manitoba Environment and Climate Change**, or sent electronically to [ods@gov.mb.ca](mailto:ods@gov.mb.ca). **MOPIA's** website has a copy of this form, or you can call **MOPIA**, to email or fax a Leak Report Form to you.

Call 204.945.7100.

Rural residents call 1.800.282.8069 extension 7100.

| OZONE DEPLETING SUBSTANCES (ODS) AND<br>OTHER HALOCARBONS LEAK REPORT FORM                                                                                                                                                                                                                                                                                                                                                                                                                                                       |                                     |                    |
|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-------------------------------------|--------------------|
|                                                                                                                                                                                                                                                                                                                                                                                                                                               |                                     |                    |
| <small>Under Section 24 of the Manitoba Ozone Depleting Substances and Other Halocarbons Regulation (103/94), a person who owns, services, installs or repairs equipment from which there has been a release of regulated a Class 1, 2 or 3 substance, accidental or not, of more than 10 kgs or 22 lbs into the environment shall immediately (within 48 hours) report the incident. Report the incident by faxing the completed information on this form to the Department of Sustainable Development at 204-945-2358.</small> |                                     |                    |
| <b>RELEASE REPORTED BY: PLEASE COMPLETE ALL INFORMATION REQUESTED.</b>                                                                                                                                                                                                                                                                                                                                                                                                                                                           |                                     |                    |
| Company                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                          | Phone                               | Fax                |
| Service Technician Name                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                          | Manitoba Certification Number (MBF) |                    |
| Company Address                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                  |                                     |                    |
| Signature                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                        |                                     | E-mail             |
| <b>ODS and OTHER HALOCARBON RELEASE INFORMATION</b>                                                                                                                                                                                                                                                                                                                                                                                                                                                                              |                                     |                    |
| Date Leak Reported                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                               | Recorded by                         |                    |
| Release Address                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                  |                                     |                    |
| Equipment Type                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                   |                                     |                    |
| Type of ODS or Other Halocarbon Released                                                                                                                                                                                                                                                                                                                                                                                                                                                                                         | Quantity Lost                       | Quantity Recharged |
| Leak Located                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                     | Yes                                 | No                 |
| Date of Leak                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                     | Leak Location                       |                    |
| Probable Cause of Leak                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                           |                                     |                    |
| Repairs Completed or to be Undertaken                                                                                                                                                                                                                                                                                                                                                                                                                                                                                            |                                     |                    |
| <small>I declare that the contents of this report are true and accurate and understand that providing false information may result in prosecution under the law.</small>                                                                                                                                                                                                                                                                                                                                                         |                                     |                    |
| <small>No notification of receipt of leak report will follow. Inquiries may be directed to Manitoba Sustainable Development information line at 204-945-7100 or <a href="mailto:ods@gov.mb.ca">ods@gov.mb.ca</a></small>                                                                                                                                                                                                                                                                                                         |                                     |                    |
| <b>FOR OFFICE USE ONLY</b>                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                       |                                     |                    |
| Date Received                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                    |                                     | Updated / revised  |



## 4) Leak Test Requirements

### Section 12 of the Regulation

1. No person shall recharge or top-up equipment that contains a Class 1, 2 or 3 substance unless the person first
  - a. conducts a leak test in accordance with the procedure approved by the Minister; and
  - b. if the leak test reveals a leak, repair the leak so that the leaking can no longer occur

See page 64 in the Appendices of this Guide for the approved procedure.

The approved leak testing methods are available from **MOPIA**. It is still mandatory to use a technique that does not allow for the venting of any refrigerant (i.e. ODS refrigerants must not be added to test for leaks).



## KEY RESPONSIBILITIES FOR COMPANIES

### Certification & Training Required for those working with Halons


Individuals and/or companies who service, recharge or repair fire protection equipment (containing halons) will need to be trained & certified. **MOPIA** administers the halon training module. Halons are restricted for use in very limited applications.

### Purchasing Regulated Parts / Refrigerants

To purchase components or substances in the Regulation, you must be certified or maintain a secondary distributor permit.


## OZONE & CLIMATE FACT

*HCFCs & HFCs contribute significantly to effects on our atmosphere dynamics. In fact, some HFCs contribute thousands of times greater to climate change than carbon dioxide. It has been projected that HFCs could contribute upwards of 30% of all GHGs by 2050, if not controlled under The Montreal Protocol.*

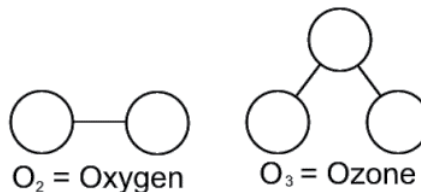

## Secondary Distributor Permits / Numbers

Companies or shops that purchase regulated refrigerants (ODS), parts or equipment containing an ODS may choose to apply for a secondary distributor permit. This allows the business to purchase and maintain ODS products under the company SD Permit rather than an employee's technician certificate. The permit generally applies to mid to larger sized companies (3+ employees) who purchase regulated products and/or ODS components, or companies who purchase product for contracting out servicing to certified technicians.

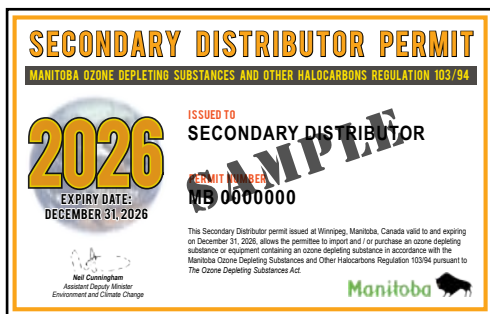

Garages, repair shops, service stations and the like may apply to receive a secondary distributor permit number (SD#). The SD# will allow the employer (company) to purchase refrigerant and/or equipment rather than using a personal certification number.



*This is a HFO 1234yf refrigerant cylinder, first seen in Manitoba in 2013. They are half the size of a typical ODS cylinder, as its introductory price is substantially higher than many HFCs.*

## Service By Trained Technician Section 6

No person other than a trained service technician shall install, repair or service air conditioning, refrigeration or other equipment containing a class 1, 2, or 3 substance.

- This applies to anyone who attaches gauges to the sealed system, recharge, service or repair an air conditioning system or refrigeration equipment but it will not apply to people who perform preventative maintenance such as changing filters or washing units. It does not apply to electronic or electrical personnel who are not working on the gas side of a unit.

## Recovery of Ozone Depleting Substances Section 7

All regulated refrigerants (i.e. HCFCs, HFCs, etc) must be recovered and recorded and never vented. A service technician shall;

- a. have available at the job site operational equipment that can recover and contain an ozone-depleting substance; and
  - b. recovers and recycles any ozone-depleting substance that would otherwise be released during the procedure.
- “Available” means, recycling/reclamation equipment must be accessible at all times. For example if gauges are placed on a unit and refrigerant is going to be put into the unit, you must have a reclaimers on sight. Any time you have a tank of refrigerant at a unit/system you must have a reclaimers on-site! If you have a leak, according to The Federal Code of Practice (2015), you must make a permanent repair. If you had a leak and thorough leak testing shows no indication of a current leak, then you may replace the refrigerant.

- Each technician, who is on their own and is in the act of charging or recharging, must have a recovery vessel or recycler available, on-site.
- In the case of a large system, such as a food store with display cases, if you can isolate the component that is leaking that you found visually or by electronic means, you would follow this example:

- 1) *pump the unit down, to evacuate the component that was leaking*
- 2) *recover the residue gas from the component*
- 3) *make the repair*
- 4) *pressure test the component that was repaired with dry nitrogen*
- 5) *pull down to 500 microns or less and hold 15 minutes or to manufacturer's specifications.*
- 6) *open the isolating valves and add refrigerant to the unit (as required)*
- 7) *record the appropriate paper work*

- In the case of an environmental emergency, call 204.944.4888 or 1.855.944.4888 (24 hours). An environmental emergency is any release or imminent release of a contaminant that may pose a risk to public health or the environment.

[www.gov.mb.ca/sd/waste\\_management](http://www.gov.mb.ca/sd/waste_management)

## Repair and Service Records to be Kept Section 8

Every technician that works on the refrigerant side of a system must keep refrigerant records.

1. a person who installs, repairs, services, recharges or does any other work referred to in Section 8, on air conditioning, fire extinguishing or refrigeration equipment shall:

- a. make a record (log book, invoice, work order, customer's bill) setting out the following:
  - the type of repair or service provided
  - date and location
  - whether an ozone-depleting substance was removed, recovered, charged or recharged
  - the type of ozone-depleting substance that has been recovered or recharged into the system
- b. leave a copy of the record with the owner or operator of the equipment that has been serviced or repaired.
  - This means a thorough record (log book, invoice, work order or customer's bill), noting the specifics of each job, must be maintained. As well, a detailed receipt must be given to the customer. Please note the example in the appendix-record data sheet and the receipt following.

### Example of a customer receipt:

|                                                                                                                                                                                                                                                                                                                                                                                                                                              |            |
|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|------------|
| <b>MOPIA A/C &amp; Refrigeration</b>                                                                                                                                                                                                                                                                                                                                                                                                         |            |
| <b>1082 Main Street</b>                                                                                                                                                                                                                                                                                                                                                                                                                      |            |
|                                                                                                                                                                                                                                                                                                                                                                                                                                              | 06/21/2025 |
| <hr/>                                                                                                                                                                                                                                                                                                                                                                                                                                        |            |
| <i>Details: Residential A/C System</i>                                                                                                                                                                                                                                                                                                                                                                                                       |            |
| <ul style="list-style-type: none"> <li>• unit found M.T. of refrigerant</li> <li>• unit leak checked (dry nitrogen)</li> <li>• leaking shredder valve repaired</li> <li>• unit leak checked (dry nitrogen)</li> <li>• evacuate &amp; dehydrate system to 500 microns</li> <li>• critical charge dialed into unit</li> <li>• unit leak checked with soap or electronic means</li> <li>• 4 lbs. - 8 oz. HCFC-22 recharged into unit</li> </ul> |            |
| Technician's Name                                                                                                                                                                                                                                                                                                                                                                                                                            |            |
| MB 19761                                                                                                                                                                                                                                                                                                                                                                                                                                     |            |

See Page 61 for an example of a Record Form

## Use of ODS Sterilant Section 9

- ODS Sterilants are prohibited for use.

## *Use of ODS Solvent*

### *Section 10*

- No person shall use a Class 1 substance to dissolve another substance for the purpose of commercial cleaning of electrical or electronic equipment.
- Since January 1, 1996, no person shall use a Class 1 substance to dissolve another substance for the purpose of cleaning any object or thing.

## *Flushing and Testing*

### *Section 11*

1. No person shall add a Class 1, 2 or 3 substance to any equipment for
  - a. flushing or leak testing the equipment; or
  - b. testing fire extinguishing equipment.

## *Addition of Contaminants Prohibited*

### *Section 14*

- No foreign material, substance or waste is to be added, mixed or dissolved into a recovered ozone-depleting substance. The addition of dye detection materials to show leaks in refrigeration systems is not considered a contaminant by most refrigerant manufacturers. The mixture of another refrigerant or other products to an existing refrigerant (cocktail) will not be accepted by refrigerant manufacturers for reclaiming and is a violation.

## *Disposal of Equipment or Refrigerant*

### *Section 16*

- All ODSs must be recovered or recycled from air conditioning, fire extinguishing or refrigeration equipment prior to their disposal. An ODS decommissioned label should be applied to the product. Contact **MOPIA** for details.

- All registered vehicles A/C in Manitoba sent through MPI are decommissioned formally.
- White goods must have their refrigerant recovered before scrapping. Some cities and municipalities offer or allow white goods disposal at their dumps (waste disposal grounds) free or for a fee. Contact your municipality for details.

## *Return of Class 1, 2 or 3 ODSs to Sellers*

### *Section 17*

- Sellers of regulated substances must accept back product they sell from a certified technician. The intent is the wholesale will work with RMC or others to properly dispose of the product(s).

## *Sale of Class 1, 2 and 3 ODSs in Containers or Equipment*

### *Section 19*

- The sale, transfer or display of an ozone-depleting substance and/or product may only be made to a trained service technician or secondary distributor. (Note: This also includes HCFCs, rooftop units, split systems and any other equipment that makes up or is attached to a closed refrigerant loop).
- Please note that you may only sell to individuals who have presented their certification card at the time of purchase or secondary distributors.
- It is highly discouraged to sell parts / refrigerant over the phone or internet unless you can guarantee the product will be used by that specific card holder or secondary distributor. The onus is on you to ensure the proper sale transaction and documentation has occurred. You must verify that numbers are valid. Contact **MOPIA** for details.



- White goods must have refrigerant recovered before being crushed / recycled. Municipal waste disposal grounds (local dumps) across Manitoba often accept, offer options or have conditions on accepting white goods. See municipal waste and links here:

[www.gov.mb.ca/sd/mb\\_recycling](http://www.gov.mb.ca/sd/mb_recycling)

## Certification of Technicians Section 20

**MOPIA**, RRC Polytech & Assiniboine College, RSES and HRAI offer certification training for technicians handling regulated ODSs.

Certain trades are recognized in Manitoba and require additional apprenticeship credentials to work on HVAC/R or air conditioning systems, in addition to your **MOPIA** certification. For instance, anyone working with regulated ODSs require **MOPIA** certification in addition to their trade accreditation (where applicable).

1. The Minister may certify a person as a trained service technician if he/she has completed a course in the proper repair, recovery and recycling procedures including the recovery of ozone-depleting substances. This is not a trade license. It only refers to training with regard to environmentally safe practice. Technicians are subject to trade certification requirements which may be under the authority of Apprenticeship Manitoba  
<https://www.gov.mb.ca/wd/apprenticeship/>
2. The Minister may issue certification numbers to persons who have successfully completed a recognized certification program which includes passing an examination. **MOPIA** offers one-day certification classes throughout Manitoba on an ongoing basis.



- Your wallet certification card (shown above) allows you to purchase regulated refrigerants and equipment / parts in Manitoba. Servicing, repairing, charging, recharging air conditioning, refrigeration and halon equipment may require trade designation, as per Manitoba Apprenticeship.
- Contact **MOPIA** if you require details on when, where and who offers recognized Regulation and environmental awareness certification courses.

## Labels Required on Equipment Section 25

**MOPIA** maintains a supply of recognized labels for your purchase. You may create similar labels yourself, as long as they are consistent to the standard.

### New Equipment:

- All new air conditioning, refrigeration or fire extinguishing equipment must display a prominent and permanent label that indicates the type of gas contained. The labels found on most newer model domestic refrigerators, car air conditioners and commercial equipment are acceptable. They should include or be similar to the samples shown (A and B) on page 36.

### Recharging:


- This requirement is intended for retrofits of existing units, when changing refrigerant gases, or built up systems that have no fixed label on them. Please take note of example on page 36 (see B):
- The required label must include the following:
  - a) type of refrigerant
  - b) date of recharging
  - c) name of person or business that performed the service

# REQUIRED LABELS



## A - WARNING LABEL


All A/C units operating with an ODS should have this affixed to the unit.



## B - ODS-UNIT ID

All A/C units must have a label identifying the refrigerant type and quantity. If you are

retrofitting a unit with a different gas, ensure it has a new label. Any time a refrigerant is substituted, you must affix a new **ODS-UNIT ID** label on the unit.



## C - REFRIGERANT RECOVERED DECLARATION

Use this label when the unit has had the refrigerant recovered. This identifies it as empty and available for recycling, scrap or other purposes. These are commonly used on vehicle write-offs and white goods.

# FOAMS

Stakeholders should be aware that federal legislation and policies negotiated under The Montreal Protocol do affect the manufacture and importation of foams containing ODSs.

Remember, the actual Regulation 103/94 text should be consulted for any & all legal interpretations.



For more information, visit [www.cufca.ca](http://www.cufca.ca)

# OZONE & CLIMATE FACT

*If we continue using and exploiting the earth's resources at our current rate of consumption, we eventually would need 1.7 planets to support the demand on the earth's ecosystems.*


*Climate change is a challenge that spans all regions, with especially severe consequences for less developed countries.*

*CFCs and HFCs are among the most potent greenhouse gases.*

<https://www.theworldcounts.com/challenges/planet-earth/state-of-the-planet/overuse-of-resources-on-earth/story>



Bus Stop with A/C in Dubai, UAE



Over the last few years, PFAS (per- and polyfluorinated substances) have become of great environmental concern. Among the products containing PFAS are many HFO and HFC refrigerants.

To learn more on the challenge and opportunity to move to safer products, download the latest report at

<https://atmosphere.cool/hfo-tfa-report-2025>

# THE AUTOMOTIVE SECTOR

In 2021, there were 1.6 million new vehicles sold in Canada. Approximately 90% of these vehicles have air conditioning.

**See:** <https://www.statcan.gc.ca/en/topics-start/automotive>

Prior to 1995, all vehicle air conditioning contained CFC-12 as the refrigerant. Today, you will more commonly find HFCs & HFO refrigerants in new vehicles. Automotive repair specialists will have to adapt to the new and changing refrigerants and systems.

## Regular Maintenance: Never Top-up a Unit!

Manitoba has a severe climate, both in summer and winter. Most often due to this inherent weather and some manufacturer designs, certain automobile air conditioning systems require regular maintenance to reduce leaking or the potential for leaks. It is good advice to recommend that consumers place their air conditioning systems on a defrost mode at least once a month (or as recommended by the manufacturer) to reduce the risk of a leak.

Front seals and compressors have been noted as recommended areas to inspect. They are often components that take the burden of strain during our climate and our inherent pothole seasons (spring & fall).

## A Common Shop Scenario

If a consumer asks to have their air conditioner checked and you find a leak after recovering the remaining refrigerant, you should tell the consumer (point out the fault) and indicate the leak must (upon the consumer's approval) be repaired permanently.

Also, note that the compressor or other components of the A/C system may eventually fail if the unit / leak is not permanently repaired. If the consumer chooses not to have the leak repaired, do not add or replace any ODS refrigerant recovered prior to finding the leak. Otherwise, continued leaking will likely occur.

The consumer should be advised that to knowingly allow a regulated refrigerant to leak is in contravention to Manitoba's **ODS and Other Halocarbons Regulation** and that they must not use a hydrocarbon or other refrigerant to top-up the system as this is called a cocktail which is prohibited under the Regulation, as well.

Advise them that refrigerants released into the environment are harmful as they contribute to climate change and are harmful to human health. They must take immediate action to repair the leak at your shop or someone else's, but it must be done and duct tape isn't a permanent repair!

The Automotive Industries Association, Mobile Air Conditioning Society, Manitoba Motor Dealers Association and other consumer oriented "automotive" groups (such as the Canadian Automotive Association - CAA) are also sometimes good sources for further information regarding these issues.



## CFC CHILLER PHASE-OUT

CFC containing chillers in Manitoba have been restricted since 2015. This was a significant step forward in protecting our environment against ozone depletion and climate change.



## OZONE & CLIMATE FACT

*When CFCs reach the ozone layer, a chemical reaction takes place in which the CFC releases chlorine that breaks down ozone molecules. One chlorine molecule from a chlorofluorocarbon can destroy 100 000 molecules of ozone. CFCs can last up to one hundred years, continuously breaking down the ozone layer.*

*Our entire ocean ecosystem is at risk because ultraviolet rays can kill planktons, which are a fundamental part of the aquatic food chain.*

[https://www.ducksters.com/science/environment/ozone\\_layer.php](https://www.ducksters.com/science/environment/ozone_layer.php)

## HALON REQUIREMENTS

### Fire Extinguishing Agents

Halons are potent, ozone-depleting and climate change gases. While halons are no longer produced anywhere in the world and can not be imported into Canada, they remain in use in both the aviation and military sectors as well as areas identified under The Montreal Protocol as “Critical Use”. Halons continue to be used in certain other countries around the world. However, they must rely on recycled stocks of halon. Halon use in Manitoba is now limited and restricted for very definite applications (i.e. aviation or military).

Manitoba was among the most innovative and progressive jurisdictions to address halons. **MOPIA's** provincial halon working group was instrumental in creating successful strategies to eliminate non-essential halon use throughout Manitoba. Manitoba developed specific and comprehensive certification training for the industry as well as, implemented halon use permits so we could identify and monitor all users of halon in our province. **MOPIA** was actively involved and participated on Environment Canada's Halon Working Group until its demise. Since 2001, Mr. Don Thomson, (a former **MOPIA** President and current board member) has actively participated as the Canadian Representative on the UNEP's Halon Technical Options Committee (HTOC).

Halons are no longer produced or imported into Canada. Certain nations do use halons but their use is quickly diminishing.

**See:** <https://ozone.unep.org/science/assessment/teap>

# MANDATORY RECORD KEEPING

All servicing that involves the recovery and/or adding of an ODS requires record keeping on your record data sheet or a form provided by **MOPIA**. There are online, fillable record data sheets available on **MOPIA's** website.

In essence, every ounce of an ODS should be accounted for. In many instances, this may require weighing a bottle after every job. In other circumstances, recovery units or gauges are available to measure the amount of substance added or recovered.


You are free to choose or develop your own record system as long as it meets the requirements of the Regulation. It is suggested that you contact **MOPIA** prior to using a new form or system. **MOPIA** can review your record system to help ensure you are properly recording the required information.

You must submit a copy of your record data sheets once a year by February 1<sup>st</sup> to **MOPIA**. In addition, keep a copy of your records on file. Manitoba's Environment, Climate and Parks Officers are working to ensure compliance. They may visit your workplace and request evidence that records are being kept. Those who do not submit records may be prosecuted.

## Secondary Distributor Record Requirements

All shops that have been issued secondary distributor permits must maintain records. **MOPIA** provides each permit holder with a sample generic record form for their use. Indicate the type of unit you have purchased, quantity and sale information as specified in the Regulation. Records must be maintained for a period of 3 years from the date of a purchase / sale transaction.

# FEDERAL LEGISLATION

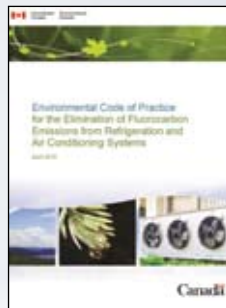

All federal government works and undertakings (i.e. rail, waterways, military, departments, First Nations communities) are governed by The Federal Halocarbons Regulations, separate from any provincial Regulations.

Information on the Federal requirements may be obtained from Environment and Climate Change Canada:

<https://pollution-waste.canada.ca/environmental-protection-registry/regulations/view?Id=129>

# THE MONTREAL PROTOCOL STORY - WHO'S WHO



UNEP DTIE Chief (retired) Mr. Rajendra Shende and MOPIA's Executive Director Mark Miller collaborated on a number of worthy international environmental initiatives for more than 20 years.

They are both notarized within UNEP's Montreal Protocol "Who's Who" Profile on Global Ozone Protection.

[https://wedocs.unep.org/bitstream/handle/20.500.11822/27278/8022OzoNewsVolXIX\\_15January2019.pdf](https://wedocs.unep.org/bitstream/handle/20.500.11822/27278/8022OzoNewsVolXIX_15January2019.pdf)



# WHITE GOODS / APPLIANCES



White goods must have their ODS recovered prior to final disposal. Your local waste disposal ground may accept your white goods, but check with them first for any fees and conditions.

White goods include such items as the following:

- a) domestic fridges
- b) domestic freezers
- c) window air conditioners
- d) any 115-230 volt self contained plug-in units:
  - i) drinking fountains
  - ii) pneumatic air dryers
  - iii) dehumidifiers (residential)



Manitoba's only comprehensive white goods recycling plant is located in Winnipeg. This plant extracts upwards of 95% of a unit's parts, including foam and refrigerants.  
[www.puresphera.com/en/](http://www.puresphera.com/en/)

# COMMON Q & A's

## What is the Code of Practice?

Environment and Climate Change Canada, in consultation with the provinces and stakeholders, developed a Code of Practice (2015) that is useful for various industry sectors in guiding them in proper procedures for servicing or handling equipment in respect to the Regulation(s). The Code is supplementary to the Regulation in Manitoba, but many provinces refer to The Code as regulatory - in other words it forms part of their regulatory approach.

Access the Code of Practice at:

<https://www.canada.ca/en/environment-climate-change/services/canadian-environmental-protection-act-registry/publications/code-practice-elimination-fluorocarbon-emissions.html>

## Are HFC 134a, 401a and similar refrigerants regulated or controlled?

Yes, HFCs including any refrigerant with a blend or mixture is regulated in Manitoba. These are Class 3 substances under Manitoba's **ODS and Other Halocarbons Regulation**.

## Is HF01234yf regulated in Manitoba?

Contact **MOPIA** regarding any recent amendments which may include new ODS alternatives or substitutes. In general, handle all products safely as if they were regulated and potentially harmful to you and the environment.

## Can a unit (i.e. car, fridge, freezer, air conditioner refrigeration unit) be topped up?

No! A service technician must first and always recover the remaining ODS, then check for leaks, permanently repair the leak and then they may replace the refrigerant with the recovered and/or virgin product.

## *How do individuals become certified?*

In Manitoba, some community college programs include certification training. **MOPIA** offers correspondence, on-line and in-class training. Visit [mopia.ca](http://mopia.ca) for details.

## *How do I become directly involved with MOPIA?*

**MOPIA** is non-exclusionary. You may become as active as you wish by becoming a member. We will provide you with meeting notices and supplemental information to get you started. **MOPIA** is an International success story. Call 204.338.2222 for a membership application. Be part of the solution!

## *Who should I call to report a negligent act?*

**Manitoba Environment and Climate Change** Officers follow-up on tips or issues of non-compliance. A list of the regional offices is on page 77 of the appendix.

## *Who can I sell ODS equipment / components to?*

Only to certified technicians or secondary distributors. Includes items such as compressors, refrigerant, coils, lines, etc., as indicated in the Regulation.

## *It says to report a leak over 10 kg in the Regulation, but to who and how “immediately”?*

Reporting an ODS leak (unintentional/intentional) over 10 kgs/22 lbs. is mandatory. Whether you have come to a system or job site that has lost its charge or have accidentally damaged a line / component, leaks must be documented. Complete a Leak Report form and send to **Manitoba Environment and Climate Change** by fax (204.948.2338) or to [ods@gov.mb.ca](mailto:ods@gov.mb.ca). Document the site details such as location, type of system, amount of ODS lost to the atmosphere, cause of the accident and what was done to stop any further leaking. Leaks over 22 lbs. should be reported within one day of the incident.

## *The leak was not my fault, I came to the system and it was empty or leaking (over 10 kgs / 22 lbs) Do I still have to report it?*

Yes, whether intentional or not, you must report a loss of an ODS over 10 kgs. It does not automatically mean you will be charged. More importantly it means you are complying with the Regulation. You must report these leaks by calling 204.945.7100.

## *What do I do with my old fridge, freezer or old car I wish to dispose of?*

You must ensure the ODS (refrigerant) has been recovered before scrapping or in some cases selling (i.e. for scrap). Some municipalities in Manitoba have contractors who may come to your home or the local dump to recover the ODS in a unit. You should contact your local waste disposal ground or municipal office to see if they have such an arrangement.



In some urban centres, appliance shops or scrap yards may offer to recover the ODS from your appliance for a fee. In addition, the City of Winnipeg may be contacted to pick-up a “white good” (appliance). For details, call 311 in Winnipeg.

Also check Efficiency Manitoba for any rebates or appliance recovery programs that apply.

<https://www.efficiencymb.ca>

## *What role does Environment & Climate Change Canada play regarding ODSs?*

Environment & Climate Change Canada enforces Regulations dealing with the import, export, manufacture, use and sale of various ODSs. For example, only authorized importers can bring regulated ODSs into Canada. Export permits are required. Sale, importation and manufacture of most aerosol containers (10 kilograms or less of CFCs) are prohibited. There are also restrictions on ODSs in food and beverage containers. Environment Canada works with other provinces, including MOPIA, to facilitate compliance with The Montreal Protocol.

See CEPA legislation:

<https://pollution-waste.canada.ca/environmental-protection-registry/regulations/view?id=14>

## *Where can I get additional labels, Regulations, compliance guides, etc?*

Labels are available for purchase through **MOPIA**. Visit our website for details.

## *If I'm working on a unit, can my apprentice or assistant hook up gauges, recover and / or replace ODS gas?*

Absolutely not, unless the person has a valid Manitoba ODS certification card issued through **MOPIA**.



## *Do facilities exist to destroy ODSs?*

Facilities in the USA exist to handle contaminated and recovered ODSs. As well, there is a potential site in Alberta (Swan Hills). ODSs are permanently destroyed by high temperature combustion (incineration).

Refrigerant Management Canada supports the disposal of surplus and contaminated refrigerants from the stationary air conditioning and refrigeration sectors. Visit: [www.refrigerantmanagement.ca](http://www.refrigerantmanagement.ca)

## *What are other provinces doing about ODSs?*

In Canada, all provinces have ODS legislation in the form of Regulations. In general, they are all quite similar but do differ on certain specific issues. If you are planning to work in another province, contact their respective provincial Department of Environment for information on their ODS Regulations. Contact **MOPIA** for more information on other provincial ODS legislation.

## *How often & where do I send the record data sheets?*

Send them once a year by February 1<sup>st</sup> to **MOPIA**, via email, fax or mail.

After every job, you must record the amount of ODS added and other job specific details.

Also, use different sheets for different ODSs. This will allow you to run down or add up the balance. It will be easier to follow and identify when a tank is full of recovered ODS (if you don't immediately replace recovered ODS into the unit you are working on).

### *What is the purpose of annual renewal?*

Annual renewal was designed to ensure constant contact with those maintaining ODS certification. Also, many individuals come & go in the industry and this will better ensure the accuracy of who is working with ODSs at any given time. Other statistical information can be collected through questions on the renewal forms. Note that the renewal is also designed to assist **Manitoba Environment and Climate Change** Officers and for statistical data.

### *What should I do if my card is stolen, lost or misplaced?*

Contact **MOPIA** immediately. **MOPIA** may re-issue you a new card & number.

### *What type of scale must I use?*

Any scale that is accurate within 10%. At this time no specific scale has been designated by the Regulation. However, federal guidelines are being assessed and will be made known to you.

### *Are there any standards for reclaim / recovery units?*

They must be accurate, fully functional and preferably IULC, CSA or ARI approved.

Halons - ULC/ORD - cL058.5-2004

Refrigerants - ARI standard 740-98

see sections 7(2) and 7(3)

### *Can I purchase a hydrocarbon or other replacement refrigerant over the counter and drop-it-in my A/C system?*

Various (unregulated) hydrocarbon and substitute refrigerants are being sold at retail outlets. If they are being sold to the public, they must only be non-regulated (not ODSs) gases, including hydrocarbons and certain other substances. They are sold under the RedTek, Duracool, Repla and several potential other brands. These substances may be purchased by the public without being certified, but - they must not add these substances into an A/C system that contains a regulated substance as this is creating a cocktail or mixture, prohibited by the legislation. In addition, many of these substances may interact poorly or potentially damage the A/C system in this manner as the original equipment may not have been designed to work with the new or alternative substance without further retrofitting or parts or equipment. In all cases, the public should research, consult or have a certified trained technician service the equipment, as they have the training, specialized tools and equipment to properly service systems. Venting any HCFC or HFC to the environment is punishable by penalties under the Act, intentionally or by accident.

### *Is HFO 1234yf refrigerant compatible with HFC 134a air conditioning systems?*

Generally, no. New recovery units and other air conditioning components may be required. Consult the manufacturer before using any new refrigerant, or you risk voiding your warranty or worse, damaging equipment.

## *Out of Province Sales*

An out of province purchaser who is working in Manitoba must be certified. An out of province purchaser outside Manitoba may purchase refrigerant if:

- a. they have certified technicians
- b. they conform to Regulation 103/94 responsibilities
- c. have contacted **MOPIA** regarding a secondary distributor permit

## *Sales of split systems to non-certified persons*

The sale of split systems must be to certified technicians and secondary distributors only.

## *Certification of counter-persons*

Counter-persons should receive instruction / education but not certification provided they do not hook up hoses, charge, service or repair units. Technical representatives should be certified as they demonstrate products and techniques.

## *Certification of students in a classroom*

Students in a learning environment (high school) will function under the certification and guidance of the instructor. Students must obtain certification if they are handling regulated products.

## *Reclaim units purchase inquiries*

Recycling units should be CSA approved, ULC approved for purity (Air Conditioning and Refrigeration Industry), ARI-700 standard for purity or the SAE-J1991 standard for purity, ARI-740 standard for performance. Home built recovery units should only be constructed with the approval of the Department of Labour and Immigration.

[www.gov.mb.ca/labour](http://www.gov.mb.ca/labour)

## *Tag on equipment*

A service record of maintenance and repair should be attached to equipment to provide a service history for future technicians as well as the owner.

## *Discharge of contents from a hose: reclaim*

The maximum length of hose without shut off valves is to be limited to 36". You may use any length of charging hose as long as you can shut off and isolate the refrigerant in the hose and remove the refrigerant with a recycler or a recovery unit.

## *Approved Cylinders*

Use only approved cylinders – Department of Transportation approved. (Propane tanks are not acceptable.) Cylinders must be colour coded in accordance to Workplace Hazardous Materials Information System (WHMIS). They must also be refillable and recyclable. For more: [www.tc.gc.ca/eng/tdg/moc-cylinder-menu-363.html](http://www.tc.gc.ca/eng/tdg/moc-cylinder-menu-363.html)

## *Appliance sector*

The appliance sector may require that only virgin quality refrigerant products are used otherwise the warranty is null and void. All domestic appliance technicians should be aware that this direction is from the appliance manufacturers' associations. (Some service shops have been recycling CFC-12 for years successfully.) The onus and liability for refrigeration system failure will be the responsibility of the service technician.

## *Weights and measures*


At present scale and record keeping requirements (provided they are accurate within 10%) are acceptable for record keeping purposes.



# APPENDICES


## OZONE IN THE ATMOSPHERE

In the upper atmosphere, a protective layer of ozone ( $O_3$ ) shields us from the sun's damaging rays, while at ground level this same gas is a serious air pollutant (smog). Most of the ozone in the atmosphere occurs between 15 and 40 km, with the heaviest concentration between 20 and 30 km. Compressed it is only 3mm thick.

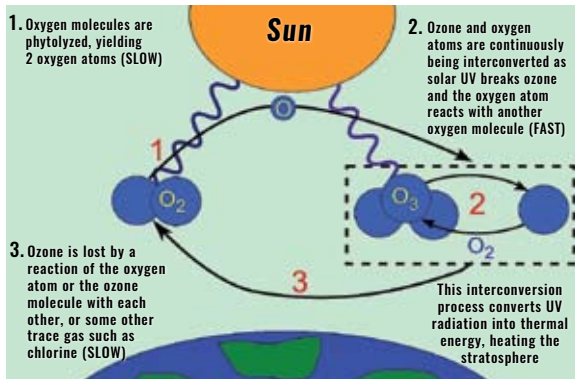


<https://www.worldatlas.com/articles/what-is-the-ozone-hole.html>

### Visual on how various ODSs affect the Stratosphere/Atmosphere

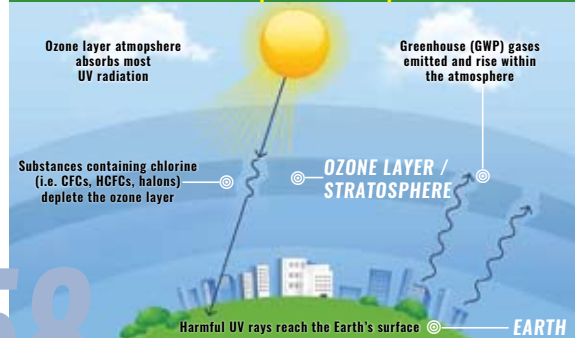

## CLIMATE CHANGE DYNAMICS

Global warming / climate change is caused by the accumulation of certain gases in the atmosphere due to human activities. These gases prevent the sun's rays from escaping the earth's atmosphere after having bounced off the earth's surface. Some of the gases which are contributing to the greenhouse effect are carbon dioxide, nitrous oxide, methane, CFCs and some of their alternatives (such as HFCs). The impacts of climate change are significant and far reaching.

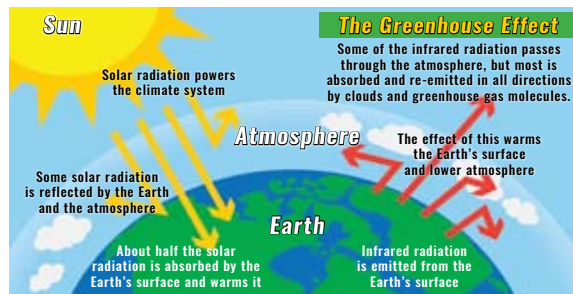

1. Solar energy penetrates the Earth's atmosphere
2. Most of this energy is absorbed by the Earth's surface and re-emitted as infrared radiation.
3. Greenhouse gases absorb and re-emit some of this radiation, warming the Earth's surface and the lower atmosphere.

## RECENT CLIMATE REPORTS

Canada's Changing Climate Report

<https://www.canada.ca/en/environment-climate-change.html>

Global Climate Change

<https://www.ncdc.noaa.gov/sotc/global/>

World Meteorological Organization

<https://public.wmo.int/en/our-mandate/climate/wmo-statement-state-of-global-climate>

# OZONE DEPLETING POTENTIAL (ODP) & GLOBAL WARMING POTENTIAL (GWP)

Common refrigerants and Ozone Depletion Potential (ODP) and Global Warming Potential (GWP) are indicated below.

- Ozone Depletion Potential (ODP) of a chemical compound is the relative amount of degradation it can cause to the ozone layer
- Global Warming Potential (GWP) is a measure of how much a given mass of a gas contributes to global warming. GWP is a relative scale which compares the amount of heat trapped by greenhouse gas to the amount of heat trapped in the same mass of Carbon Dioxide. The GWP of Carbon Dioxide is by definition 1. Be aware that GWPs are highly controversial.

| Refrigerant                              | Ozone Depletion Potential (ODP) | Global Warming Potential (GWP) |
|------------------------------------------|---------------------------------|--------------------------------|
| R-11 - Trichlorofluoromethane            | 1.0                             | 4000                           |
| R-12 - Dichlorodifluoromethane           | 1.0                             | 2400                           |
| R-1234yf - Hydrofluoroolefin             | 0                               | 4                              |
| R-13 B1 - Bromotrifluoromethane          | 10                              | 0                              |
| R-22 - Chlorodifluoromethane             | 0.05                            | 1700                           |
| R-32 - Difluoromethane                   | 0                               | 650                            |
| R-113 - Trichlorotrifluoroethane         | 0.8                             | 4800                           |
| R-114 - Dichlorotetrafluoroethane        | 1.0                             | 3.9                            |
| R-123 - Dichlorotrifluoroethane          | 0.02                            | 0.02                           |
| R-124 - Chlorotetrafluoroethane          | 0.02                            | 620                            |
| R-125 - Pentafluoroethane                | 0                               | 3400                           |
| R-134a - Tetrafluoroethane               | 0                               | 1300                           |
| R-143a - Trifluoroethane                 | 0                               | 4300                           |
| R-152a - Difluoroethane                  | 0                               | 120                            |
| R-245a - Pentafluoropropane              | 0                               | 0                              |
| R-401A (53% R-22, 34% R-124, 13% R-152a) | 0.37                            | 1100                           |
| R-401B (61% R-22, 28% R-124, 11% R-152a) | 0.04                            | 1200                           |
| R-402A (38% R-22, 60% R-125, 2% R-290)   | 0.02                            | 2600                           |
| R-404A (44% R-125, 52% R-143a, R-134a)   | 0                               | 3300                           |
| R-407A (20% R-32, 40% R-125, 40% R-134a) | 0                               | 2000                           |
| R-407C (23% R-32, 25% R-125, 52% R-134a) | 0                               | 1600                           |
| R-502 (48.8% R-22, 51.2% R-115)          | 0.283                           | 4.1                            |
| R-507 (45% R-125, 55% R-143)             | 0                               | 3300                           |
| R-717 Ammonia - NH3                      | 0                               | 0                              |
| R-718 Water - H2O                        | 0                               | 0                              |
| R-729 Air                                | 0                               | 0                              |
| R-744 Carbon Dioxide - CO2               | 0                               | 1*                             |

\* CO2 is the GWP reference

# FEDERAL HALOCARBON REGULATIONS

Federal facilities and undertakings are governed by Canada's Halocarbon Regulations, under the authority of the Canadian Environmental Protection Act.

MOPIA recommends you consult these Regulations specifically, as they are federal, not provincial in scope.

## Canadian Phase-out

### HFC PHASEDOWN IN CANADA

- Ozone-depleting Substances and Halocarbon Alternatives Regulations (ODSHAR) implement Canada's phasedown of HFCs
- Ensures that Canada meets its international obligations under the Montreal Protocol, including the Kigali Amendment



Table 1: Canada's HFC consumption phase-down schedule

| YEAR | Reduction from Baseline (%) | Canada's maximum allowable HFC consumption (tonnes CO <sub>2</sub> equivalent) |
|------|-----------------------------|--------------------------------------------------------------------------------|
| 2019 | 10                          | 16 207 916                                                                     |
| 2024 | 40                          | 10 805 277                                                                     |
| 2029 | 70                          | 5 402 639                                                                      |
| 2034 | 80                          | 3 601 759                                                                      |
| 2036 | 85                          | 2 701 319                                                                      |

### Q & A's on HFC regulatory amendments:

<https://www.canada.ca/en/environment-climate-change/services/canadian-environmental-protection-act-registry/ozone-regulations-amendments-questions.html>

### HFC phase-down fact sheet:

<https://https://cscb.ca/sites/default/files/legacy/1.%20EN%20-%20FactSheet%20HFC%20Phasedown.pdf>

### HCFCs (continued)

#### Jan. 1, 2015:

Annual allowable amount of HCFCs reduced by 90%

#### Jan. 1, 2020:

Annual allowable amount of HCFCs reduced by 99.5% except HCFC-123, which can be imported or manufactured until 2030 to service large air conditioning units (chillers) under the remaining .5% allowance. No new HCFC equipment to be manufactured or imported.

#### Jan. 1, 2030:

HCFCs no longer permitted to be imported or manufactured.

### HFCs:

Canada has adopted the Kigali Amendment of The Montreal Protocol. This includes phasing down HFC consumption, which began in 2019 by 10%, and we'll see further reductions including a cut of 85% by 2036. Visit Canada's HFC phase-down plan at:

<https://www.canada.ca/en/environment-climate-change/services/canadian-environmental-protection-act-registry/ozone-regulations-amendments-questions.html>

### HBFCs:

100% elimination by January 1, 1996\*


### METHYL BROMIDE:

- Freeze began January 1, 1995  
(Except quarantine and pre-shipment applications)
- \* The Parties agreed on a provision for possible exemptions to the phase-out dates for "essential uses", to be determined by the UNEP Technology and Economic Assessment panel according to essential use criteria adopted by the Parties. Canada will consider such exemptions on a case by case basis.
- \*\* Controls on HCFCs relate to consumption only, not production. Controls for all other substances relate to production and consumption (consumption = production + imports - exports).

For additional Canadian ODS phase-out information, see: <https://www.canada.ca/en/environment-climate-change/services/canadian-environmental-protection-act-registry/consultation-2019-modification-ozone-depleting-substances-regulations.html>

## EMERGING FACTS & STATS

Without mitigating actions, global temperatures are projected to rise by 4°C above pre-industrial levels by the end of the century.

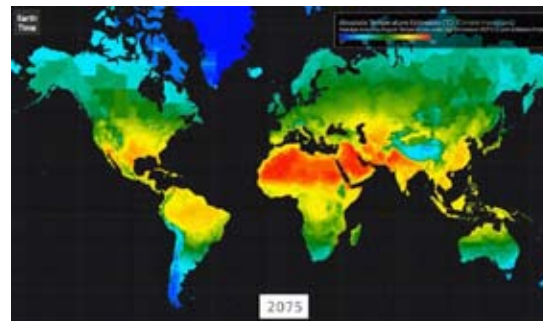

Source: World Economic Forum

See: [www.noaa.gov/climate](http://www.noaa.gov/climate)



[www.realalternatives.eu](http://www.realalternatives.eu)

Get certified with CO2 and other natural refrigerants.



**EASY. SAFE. FREE.**  
THERMOSTAT RECYCLING

It began in 2006 with the goal of encouraging the uptake of newer, more energy efficient programmable thermostats, the Thermostat Recovery Program (TRP) is Canada's safe and responsible collection and disposal service for unwanted mercury-containing and electronic thermostats.

Thermostats contain approximately 2.5-10 grams of mercury, and so the safe collection and disposal of mercury is critical, keeping it out of Manitoba's landfills and water tables.

Find a TRP depot nearest you at:

<https://www.hrai.ca/trp>

[illegible]

Submit a copy of this info by **Feb. 1st** every year for the previous years ODS work records (January 1- December 31).

Every time a regulated refrigerant is recovered or added (charged/recharged) into an A/C or refrigeration system, the type of refrigerant, quantity, and related info must be recorded and also submitted (once per year) by February 1 to **MOPIA** including the service technician's certification number and name. If you did not use any regulated substance during a given year, you must still report to **MOPIA** your "no use" status.

Record data sheets are available on **MOPIA's** website, or you may create your own in-house, as long as they record the required info including date, type of refrigerant, amount, service reference or detail, etc.

## REFRIGERANT DISPOSAL

Refrigerant Management Canada (RMC) is a not-for-profit corporation administered by the Heating, Refrigeration and Air Conditioning Institute of Canada (HRAI) and the Canadian refrigeration and air conditioning industry. The program is an industry-led environmental care program committed to the responsible disposal of surplus ozone-depleting refrigerants such as CFCs and HFCs from the stationary refrigeration and air conditioning industry sectors. Visit: [www.refrigerantmanagement.ca](http://www.refrigerantmanagement.ca)

## OZONE & CLIMATE FACT

*Chlorine is considered a major factor in stratospheric ozone depletion. However, chlorine from swimming pools, household bleach and sea salt (sodium chloride) does not contribute to ozone destruction due to the fact that they are water soluble and reactive. Therefore, these chemicals are removed from the lower atmosphere, never reaching the stratosphere in significant amounts. However, human-made halocarbons, such as CFCs, are able to migrate to the stratosphere because they are extremely stable compounds and have the potential to destroy thousands of ozone molecules.*

Visit: [www.ozonelayer.noaa.gov/science/basics.htm](http://www.ozonelayer.noaa.gov/science/basics.htm)



*Mark Miller and Bernie Kozmeniuk in Dauphin. Bernie was an original member of Manitoba's ODS working group back in 1993, and continues to service white goods in the parkland region of Manitoba.*

## APPROVED LEAK TESTING

You must eliminate the venting of any regulated refrigerant or replacement gas, it is mandatory to leak test by not adding any ODS. Where possible, use nitrogen and/or soap & water, as the known industry standards. Other methods are acceptable (see below).

Please note that it is also good practice to recover non-ODS refrigerants. Some of these substances are potentially harmful as heat trapping greenhouse gases and/or may be harmful to human health. Separate recovery units are required to contain the various refrigerants. Cross contamination of refrigerant gases may cause air conditioning equipment damage if replaced in a unit and is contrary to the Regulation. In addition, contamination of an ODS is prohibited in the Regulation.

### Approved leak testing methods

Under ***The Manitoba Ozone Depleting Substances and Other Halocarbons Regulation*** (Section 12), no person shall recharge or top-up equipment that contains an ozone-depleting substance (ODS) unless the person first conducts a leak test and repairs the identified leak permanently. Technicians may choose one or more of the following leak test methods to ensure a unit's system is/will work effectively after any ODS is added following the system's repair. The following is the prescribed leak test procedure and list of acceptable leak testing methods recognized by **Manitoba Environment and Climate Change**. They are subject to change.



## Prescribed leak test procedures

1. If the system still contains an ozone-depleting substance (ODS), proceed to item #3.
- 2- If the system has lost its charge and no longer contains an ODS, it must first be pressurized to a minimum of 150 psi (1034 kPa) or such a pressure as not to rupture the system using dry nitrogen.
- 3 Use one of the appropriate method(s) indicated under “Acceptable Leak Testing Methods” to detect the presence and location of a leak.
- 4 If no leak is detected after fully and thoroughly leak checking, you may recharge the system.
5. If a leak is found, isolate that component if possible. Recover any ODS from the component or system.
6. Once any remaining ODS has been recovered, repair or replace the component or system.
7. Perform another leak test method to confirm that the leak has been repaired. If any leaks are found, repeat items #1-7 until all leaks have been repaired.
8. Evacuate the system in accordance with the manufacturers recommended evacuation/dehydration levels. When the manufacturers information is unavailable evacuate to 29.87 in Hg. (500 microns) and hold for a minimum of 10 minutes (as described in the “Acceptable Leak Testing Methods” Standing Vacuum Test).
9. The system has now been evacuated and dehydrated. The system must now be recharged using the same ODS or replacement refrigerant in accordance with the Manufacturers Certified Installation, Specifications and Service Manuals

and the Code of Practice for the Reduction of Chlorofluorocarbon Emissions from Refrigeration and Air Conditioning Systems (published by Environment and Climate Change Canada). These items are subject to the Minister’s approval and amending and updating.

An ozone-depleting substance must not be added to nitrogen or dry air for use as a trace gas. However, you may use the remaining (remnant) ODS gas that was in the system to immediately check for leaks.

## Acceptable leak testing methods

There are many different techniques for leak testing, with varying degrees of accuracy depending on the system being tested. The following guidelines are acceptable procedure for leak testing of various stationary refrigeration and air conditioning systems.

The following techniques have been identified by **MOPIA** and are acceptable by **Manitoba Environment and Climate Change**. The most appropriate leak test method for the circumstance should be chosen and performed by an ozone-depleting substances certified individual (“trained service technician”). The completion of a leak test is not a guarantee against leaks in the future, and therefore is not meant to replace an existing preventative maintenance program.

1. Electronic leak detection
2. Halide flame leak detection
3. Soap and bubble test
4. Ultrasonic leak detection
5. Fluorescent dye leak detection
6. Standing vacuum test
7. Standing nitrogen pressure test

**Please note:** Any additional leak testing technologies that are developed and accepted within the refrigeration and air conditioning industry may become acceptable and added to these guidelines. They must first be approved under M.R. 103/94. It is recommended that you periodically check with **MOPIA** for the latest list of acceptable leak test procedures.

## AUTO OZONE FACT

*Mobile/Auto air conditioning is in upwards of 85% of new vehicles manufactured and has accounted for among the largest single source of ODS related GHG emissions.*

*It's critical/mandatory to permanently repair leaks and never top-up a refrigerant. The use of over the counter hydrocarbon refrigerant kits must have any ODS refrigerant recovered first - no cocktailing/blending as this is contrary to the Regulation and may damage the A/C system.*

*The use of hydrocarbon refrigerants, available for purchase from retail stores, must only be used when an A/C system manufacturer specifies its use. Never add a hydrocarbon refrigerant into a system that has a different type of refrigerant in it. This can cross contaminate and damage the A/C unit, and in addition is contrary to the Manitoba ODS Regulation to cocktail or mix refrigerants in any system.*



For more information:

[www.mmda.mb.ca](http://www.mmda.mb.ca)

[www.mucda.mb.ca](http://www.mucda.mb.ca)

[www.macsw.org](http://www.macsw.org)

[www.atamb.ca](http://www.atamb.ca)

## CERTIFICATION TRAINING

**MOPIA** offers certification training for technicians servicing HCAC/R and other refrigerant containing equipment. Online learning as well as correspondence packages are currently available. **MOPIA** also offers in classroom training as public health restrictions permit.

Since 1993, over 20,000 people have been trained and certified in Manitoba.

**MOPIA's** certification training focuses on environmental and Regulation awareness. It is not a replacement for any trade, industry hands-on or practical experience. It is mandatory to have and maintain this certification for anyone working on the gas side of a HVAC/R and other refrigerant containing systems/equipment. Penalties for non-compliance or not being certified include up to \$50,000 and/or 6 months imprisonment.



Students being taught by Mr. Botho Kramer, one of **MOPIA's** certification trainers who was an RRC Polytech HVAC/R instructor for over 30 years.

# PRODUCT RECOVERY / STEWARDSHIP

**MOPIA** is collaborating with Indigenous Services Canada and First Nations communities across Manitoba to provide capacity building and refrigerant environmental stewardship resources.

Across Manitoba, several communities (both urban and rural) including some First Nations have waste disposal grounds or areas where abandoned autos, white good appliances and other equipment that contains a potent greenhouse gas refrigerant are disposed. **MOPIA** is conscious of the challenges of their proper stewardship and is continuing to determine reasonable approaches to find solutions.

## ENFORCEMENT & PENALTIES

Non compliance under provincial and federal Regulations controlling refrigerants and ODSs are liable for penalties, fines and possible prison sentencing.

Penalties for non-compliance exist for technicians AND companies. They include fines of up to \$50,000 and/or 6 months imprisonment and much higher for companies. You **MUST** be certified to handle regulated refrigerants and submit record data forms among other responsibilities.

See details at:

<https://www.canada.ca/en/environment-climate-change/services/environmental-enforcement/contact.html>

**email: Enforcement-PNR@EC.gc.ca**

<https://www.gov.mb.ca/sd/about/environmental-stewardship/environmental-compliance-and-enforcement/contacts.html>

# INDUSTRY & PUBLIC OUTREACH

**MOPIA** has conducted a number of outreach programs to alert the industry and public on issues specific to **MOPIA's** mandate on Ozone Depleting and Climate Change Substances.

**You can't just "top up" your air conditioner**

Any conditioning refrigerant leak in any kind of equipment or system is potentially harmful to the environment and the environment. When a system is not properly repaired, the gases it contains may escape into the atmosphere, where they can contribute to global warming. A small leak from a leak hose or other source that needs to be identified and repaired immediately.

It is against the law to "top-up" refrigerant into an air conditioning system. Purchasing a cheap refrigerant from a retailer may appear to be an easy fix, but A/C systems are designed to operate with specific refrigerants and a cross mixing or containing system is illegal and potentially harmful to your equipment. Not having refrigerant in a system will not permanently repair the system and will allow the continued release of refrigerant into the atmosphere, which is also illegal, and potentially harmful to human health and the environment.

The A/C system refrigerant must be properly recovered (not released) from equipment and then repaired or replaced by a properly trained technician with specialized refrigerant recovery equipment.

Certified service technicians are trained and responsible for the permanent leak repair of an air conditioning system. They will perform the proper leak test, recover the refrigerant and repair the leak before recharging your A/C system. They must record details of the work including the use of regulated refrigerants. Ask to see a technician's Manitoba Occupational Safety and Health (MOSH) card to ensure it is valid (expiry date) if possible.

Refrigerant gas is a greenhouse gas (or the major greenhouse gas) and is a potent climate change contributor. It is a greenhouse gas and is a potent climate change contributor.

**DO'S:**

There is a proper and recognized air conditioning leak test procedure that must follow. Leak tests may use the following techniques:

- Electronic leak detection
- Bubble flare leak detection
- Soap & bubble test
- Ultrasonic leak detection
- Fluorescent dye leak detection
- Standing vacuum test
- Standing Nitrogen test

Certified technicians can use refrigerants existing in system while performing a leak test, but cannot add any class 1, 2, or 3 refrigerants to leak test.

If no leak is found using an approved leak test protocol, refrigerant may be added.

If a leak is found, the technician must tell YOU, the customer. The owner of the equipment is then obligated to get the leak repaired, but can choose when and where this will happen. The owner must get the leak repaired before more refrigerant can be added.

**DON'TS:**

The following practices are not legal:

- Just "topping up" a leaking system
- Permitting the discharge of a refrigerant into the environment is illegal
- Continuing to run without repairing the leak. Owners should be advised by the technician of the environmental impact of their leak, and know that they can damage their A/C unit by running it without a proper charge of refrigerant
- Adding a different refrigerant than the one already in the system, which can cause a potentially dangerous chemical cocktail within your system
- CFCs must never be used in recharging an auto A/C system
- Importing regulated HFCs from the USA without proper certification or permit(s)
- Buying A/C parts or refrigerants over the internet without proper certification

**Report Improper A/C servicing to an Environment Officer with Manitoba Conservation and Water Stewardship**

Find an Environment Officer at:  
[www.gov.mb.ca/conservation/eco/contact](http://www.gov.mb.ca/conservation/eco/contact)

For the full regulation, visit:  
[www.gov.mb.ca/conservation/pollutionprevention/ods](http://www.gov.mb.ca/conservation/pollutionprevention/ods)

**This 2015 Bulletin courtesy of:**

**MOPIA.ca**  
 1-888-667-4203  
 204-338-2222  
[www.mopica.ca](http://www.mopica.ca)  
[mopica@mymts.net](mailto:mopica@mymts.net)

**Louise Gifford-Parker**  
**MOPIA Executive Assistant**

*Topping-up A/C systems of any kind with a regulated refrigerant is prohibited. A complete leak test must be performed to permanently repair a leak before additional gas is added.*

*Adding a hydrocarbon or other substitute refrigerant into a system that contains a different regulated refrigerant is also prohibited and may cause system / equipment damage.*

# REGULATED PRODUCTS

**MOPIA** has issued several purchasing bulletins, including this one which highlights who may purchase regulated refrigerants and parts. Visit our website or contact **MOPIA** if you would like a copy to post.

**Who may purchase Refrigerants and A/C Equipment & Parts?**

Only companies that have a Secondary Distributor Permit and/or individuals who are recognized as a Manitoba Certified Service Technician may purchase and import regulated air conditioning (HVAC/R type products) into Manitoba.

Regulated products include nearly all refrigerants (including CFCs, HCFCs & HFCs) and any new or used equipment or components that make up or attach to a closed refrigerant loop.

It is a violation to sell any regulated product to a company or a person who does not either have a valid SD Permit or a valid personal certification card issued by MOPIA and authorized by the Minister of Sustainable Development (see sample below). As a seller of products, you are responsible to verify and document the permit or certification number. Significant penalties exist under the Ozone Depleting Substances Act (C.S.M. 883) for those who contravene this regulatory compliance responsibility.

See it on-line at: <http://www2.gov.mb.ca/news/mofa/csa/odsb99.pdf>

**Two ways to purchase or import Refrigerant and A/C Equipment & Parts**

**Secondary Distributor Permit (SD Permit)**  
Annual Permit - Effective January 1 - December 31 each year  
A Secondary Distributor (SD Permit) is required in the Province of Manitoba for companies that purchase regulated (new or used) air conditioning equipment or parts and/or substances (regulated), as defined under the Manitoba ODS and Other Halocarbons Regulation. The SD Permit is intended for use by wholesalers and/or retailers, wholesalers, distributors, agricultural, auto and/or other dealerships, service centers, busy shops, other air conditioning related mechanical contractors, etc.

SD Permit holders are reminded that all transactions of regulated products must be recorded to which will result in a SD permit holder. Permits valid and this information must be made available to an Enforcement Officer upon request.

**Manitoba Certified Service Technician**  
Annual Certification - Renewable June 1 each year  
Every Manitoba Certified Service Technician who repairs their own and/or another's (except limited) (2) regulated air conditioning equipment must record their certification number on the purchase of regulated products. If a doubt, record both the certification and the certification number.

A SD Permit and/or certification is not required for purchasing White Goods (i.e. fridges, freezers), but it is for any of their parts connected to the closed refrigerant loop.

Secondary Distributors are reminded that, as per Manitoba Regulation 103/94, all transactions of regulated products must be recorded and made available to an Enforcement Officer upon request.

This purchasing bulletin was prepared for you by:  
MOPIA/CA  
Email or call us for more info: [info@mopia.ca](mailto:info@mopia.ca)  
or 204.338.2222 / 1.888.667.4203  
845 Henderson Highway, Winnipeg, Manitoba, Canada R2K 2L4

Only Certified technicians who hold a valid certification card may purchase regulated refrigerants and parts along with companies in Manitoba that hold a Secondary Distributor permit. Wholesalers and anyone selling regulated products must see/record the certification number or SD Permit number of each regulated item they are selling. Penalties for not doing so are up to \$500,000 on a first offence.

Below is one of the purchasing bulletins issued by **MOPIA** highlighting what is regulated and restricted to certified persons and Secondary Distributor Permit holders.

**Regulated Refrigerants include CFCs, HCFCs and HFCs**

The Manitoba Ozone Depleting Substances and Other Halocarbons Regulation 103/94 lists all regulated refrigerants. They include CFCs, HCFCs and HFCs, such as R134a, R12, R22, R410, R607 and their various blends. Only persons with a valid Manitoba certification card may handle (i.e. charge, evacuate an AC system) these.

Hydrocarbons (propellants type products) are not regulated under the Regulation but must not be added directly to a unit that has a regulated refrigerant (cocktails are illegal).

Refrigerant containers must be refillable (may have a core / deposit charged by the wholesaler) size compliant meeting Transport Canada (i.e. within hydrostatic test data) and Environment Canada specifications.

For more details visit: [www.tc.gc.ca/eng/tgmcc-cylinder-faq-cylinders-473.html](http://www.tc.gc.ca/eng/tgmcc-cylinder-faq-cylinders-473.html)

**All Parts (new or used) Connected to the Closed Refrigerant Loop are Regulated\***  
*Meaning the purchase and servicing is also restricted*

These products include but are not limited to items such as:

- Compressors
- Coils
- Lines
- Refrigerant
- Split Systems
- Evaporators
- Condensers
- Filter Dryers
- Road-Top Units

And anything else whereby refrigerant passes through.

**Who can purchase Regulated Refrigerant(s) and A/C Equipment & Parts?**

Regulated products include nearly all refrigerants (including CFCs, HCFCs & HFCs), any service equipment, any gauges, any containers and any new or used equipment or components that make up or attach to a closed refrigerant loop.

**Significant financial penalties**

It is a violation to sell any regulated product to a person or company who does not have a SD permit number or to a person who is not certified in the Province of Manitoba. If you are a seller of any regulated products (anything attached to the closed refrigerant loop or refrigerant), you must record (verify) whom you sold the products to (including the persons name and certification number or company SD number). Significant penalties exist for those who contravene this regulatory compliance responsibility. These include fines up to \$100,000 for persons, plus jail time and up to \$1 million for corporations and restitution, compensation and other fines as the judge warrants. Compliance enforcement does happen.

[www.canada.ca/en/environment-climate-change/services/environmental-enforcement/notifications.html](http://www.canada.ca/en/environment-climate-change/services/environmental-enforcement/notifications.html)  
[www.gov.mb.ca/sd/about/environ/climate-change/services/environmental-enforcement/notifications.html](http://www.gov.mb.ca/sd/about/environ/climate-change/services/environmental-enforcement/notifications.html)

This Regulated Products Bulletin was prepared for you by MOPIA  
Contact us for more info: [www.mopia.ca](http://www.mopia.ca) • email: [mopia@mopia.ca](mailto:mopia@mopia.ca)  
or 204.338.2222 / 1.888.667.4203  
845 Henderson Highway, Winnipeg, Manitoba, Canada R2K 2L4

Regulated products in Manitoba include all refrigerants listed within the **Manitoba ODS and Other Halocarbons Act**, including CFCs, HCFCs, HFCs and new or used equipment/parts connected to the closed refrigerant loop of an HVAC/R or air conditioning system / equipment.



Persons need certification to access regulated refrigerants and parts/equipment. Wholesalers and distributors face major penalties if they sell to persons not carrying the proper and valid certification.



**SHOW IT  
SEE IT**

# IT'S THE LAW!

**This wallet size card is mandatory for all persons servicing or purchasing regulated refrigerant(s), part(s) and equipment. The card is issued annually and is needed when purchasing refrigerant or parts on the gas side of new or used refrigeration or air conditioning systems. Companies with a valid Secondary Distributor (SD) Permit may also purchase regulated products.**

**A CERTIFICATION CARD OR SD PERMIT IS REQUIRED FOR PURCHASING**  
Cards and Permits are not transferable.

**TOUGH PENALTIES**  
Penalties exist for anyone purchasing and/or selling regulated products without a valid Certification Card. You may verify a card's validity by contacting MOPIA.

**WHOLESALE & DISTRIBUTORS**  
Anyone selling regulated new or used air conditioning and refrigeration equipment, parts and/or refrigerant are obligated to see and record a MB-number off a valid Certification Card.

**MOPIA**  
645 Henderson Highway  
Winnipeg, Manitoba, Canada  
1.800.637.4208 Toll Free  
204.669.2222 in Winnipeg  
[www.mopla.ca](http://www.mopla.ca)

**MANITOBA OZONE PROTECTION INDUSTRY ASSOCIATION**  
**MOPIA.CA**  
THE OZONE SECRETARIAT  
OFFICE OF OZONE PROTECTION

Penalties for non-compliance or illegal activity contrary to the Regulation include fines of up to \$50,000 and/or up to 6 months in prison for persons and up to \$500,000 for companies. Ensure you comply. Officers with Manitoba Environment and Climate Change, as well as Environment and Climate Change Canada enforce the Regulations. Tips are appreciated, received and are investigated.

**MOPIA** issued this consumer awareness bulletin (July 2013) to inform the public that topping-up A/C may pose negative circumstances and is illegal if a different refrigerant mixes with a class 1, 2 or 3 refrigerant. **MOPIA** hopes to generate media interest in protecting consumers from misinformation and improper A/C servicing.



**RECHARGING YOUR AIR CONDITIONING?**

## DON'T D.I.Y. DO IT RIGHT

**Don't Mix the Law.** The proper handling, filling or release of regulated refrigerants is a legal requirement. Mixing or adding different refrigerants can result in a \$5000 fine and a 6-month suspension on the Gas Act.

Four types of automobile air conditioning units (air conditioner and receiver) are equipped with refrigerants that are available to consumers at retail outlets. When you buy containers of "top up" refrigerant, remember with the 4 "P"s: "Prohibit", "Prohibit", "Prohibit", "Prohibit".

- ❌ **MIXING REFRIGERANTS MAY DAMAGE YOUR EQUIPMENT**  
There are many factory-installed refrigerant and parts that are designed to be compatible with your air conditioning system. Mixing different refrigerants can damage your equipment.
- ❌ **MIXING REFRIGERANTS IS BOTH DANGEROUS AND ILLEGAL**  
Both refrigerant leaks and mixing refrigerants can cause serious damage to your equipment, and it is illegal to mix refrigerants. Only trained and certified technicians can safely handle and mix refrigerants.
- ❌ **THE ILLEGAL RELEASE OF REFRIGERANTS IS HARMFUL TO THE ENVIRONMENT**  
Refrigerants have a significant global warming impact. Some refrigerants, such as propane and ammonia, are potentially flammable or toxic to humans.

**CERTIFIED A/C TECHNICIANS FOLLOW THE THREE R'S OF REFRIGERANT HANDLING:**  
If you have an air conditioner, you should have a check-up on your air conditioning system. It needs repair – not "topping off". You need a certified technician to do this job.

- ✓ **RECOVER** – removing refrigerant and test for leaks
- ✓ **REPAIR LEAKS** – permanent repairs, not temporary patches
- ✓ **RECHARGE** – your system with proper refrigerant

Certified A/C Technicians have the right technology to perform these tasks, and recharge your system with the right refrigerant.

**Visit [mopla.ca/issues/doitright](http://mopla.ca/issues/doitright) to learn more.**

**MANITOBA OZONE PROTECTION INDUSTRY ASSOCIATION**  
1312 Main Street, Winnipeg, Manitoba, Canada R2M 1J3  
Phone: 204.338.3315 • Toll-Free: 1.800.637.4208 • Fax: 204.338.0880



John Kubilanski (MOPIA Chair) along with Mr. Shende at a Montreal Protocol session.

See UNEP (Ozone Secretariat) at: <https://ozone.unep.org/>



# MOPIA'S TEAM



## General Inquiries:

[mopia@mopia.ca](mailto:mopia@mopia.ca)

## Phone:

(204) 338-2222

(888) 667-4203

## Fax:

(204) 338-0810

## Mark Miller

B.A., CIM, PSA(C)

Executive Director

[mm@mopia.ca](mailto:mm@mopia.ca)



## Duran Asseltine

Office Manager

[da@mopia.ca](mailto:da@mopia.ca)



## Kyran Thiessen

Office Manager

[kyran@mopia.ca](mailto:kyran@mopia.ca)



## Brianna Wall

Environmental Projects

[bw@mopia.ca](mailto:bw@mopia.ca)



*Original MOPIA staff*



*MOPIA staff team - 2021*



*MOPIA staff team - July 2024*



*Mark Miller with former National Chief of the Assembly of First Nations Ovide Mercredi*

# ENVIRONMENTAL RESOURCES / LINKS

There are a number of environmental organizations in Manitoba that are interested in atmosphere protection.

**The Manitoba Eco-Network** is the umbrella organization for most of Manitoba's environmental groups. If you require information on specific topics or need to contact other provincial groups, they are your best source for information.

[www.mbeconetwork.org](http://www.mbeconetwork.org)

**Climate Change Connection:**

[www.climatechangeconnection.org](http://www.climatechangeconnection.org)

**The Heating, Refrigerating and Air Conditioning Institute of Canada (HRAI)**

[www.hrai.ca](http://www.hrai.ca)

**Canadian Cancer Society**

<https://action.cancer.ca/en/>

**Manitoba Environmental Industries Assoc. (MEIA)**

[www.meia.mb.ca](http://www.meia.mb.ca)

**International Institute of Refrigeration**

[www.iifir.org](http://www.iifir.org)

**UN Environment OzoneAction OzoNews**

[www.unenvironment.org/ozonaction/](http://www.unenvironment.org/ozonaction/)



**MOPIA** hosted international study tours to Manitoba showcasing our innovative program approach to the world. Pictured here are representatives from UNEP, Uruguay, Burkino Faso & Bahrain

# PROVINCIAL ENVIRONMENT OFFICERS CONTACT INFORMATION

Contact the **Manitoba Environment and Climate Change** Enforcement Office nearest you:  
[www.gov.mb.ca/sd/](http://www.gov.mb.ca/sd/)

**Manitoba Environment and Climate Change**

204.250.4170

Email: [ods@gov.mb.ca](mailto:ods@gov.mb.ca)

**Leak Report Line**

Fax leak report form to: 204.948.2338

Email: [ods@gov.mb.ca](mailto:ods@gov.mb.ca)

(all leaks over 22lbs/10kgs) must be reported

**Tip Line**

To report individuals / companies out of compliance, contact your Regional Enforcement and Compliance office, as seen below.

**Environmental Compliance and Enforcement  
Contact Information**

|                  |               |              |
|------------------|---------------|--------------|
| Northeast Region | Thompson      | 204.677.6703 |
| Northwest Region | The Pas       | 204.627.8499 |
| Western Region   | Brandon       | 204.726.6565 |
| Western Region   | Dauphin       | 204.622.2030 |
| Central Region   | Portage       | 204.239.3608 |
| Central Region   | Winnipeg      | 204.945.5305 |
| Central Region   | Selkirk       | 204.785.5030 |
| Eastern Region   | Lac du Bonnet | 204.345.1486 |

**Consumer Protection Office**

204.945.3800



800.782.0067 toll-free

[www.gov.mb.ca/cc/cpo/](http://www.gov.mb.ca/cc/cpo/)

# EXTENDED PRODUCER RESPONSIBILITY & CIRCULAR ECONOMY

An end-of-life (EOL) product is one that's use is retired, or its fabrication is discontinued. A product reaches the end of its life when manufactures stop making and servicing the product. A new version of the product is often designed to replace the old one. Electronics are an example of products that are commonly discontinued and rapidly reach their end-of-life.

Extended Producer Responsibility (EPR) is a practice in which manufactures are responsible for the recovery or disposal of products they produce when they are no longer in use. This practice encourages manufacturers to makes products that are less wasteful and easier to recycle. Examples of EPR recycling and disposal programs in Manitoba include beverage containers, tires, electronics and batteries.

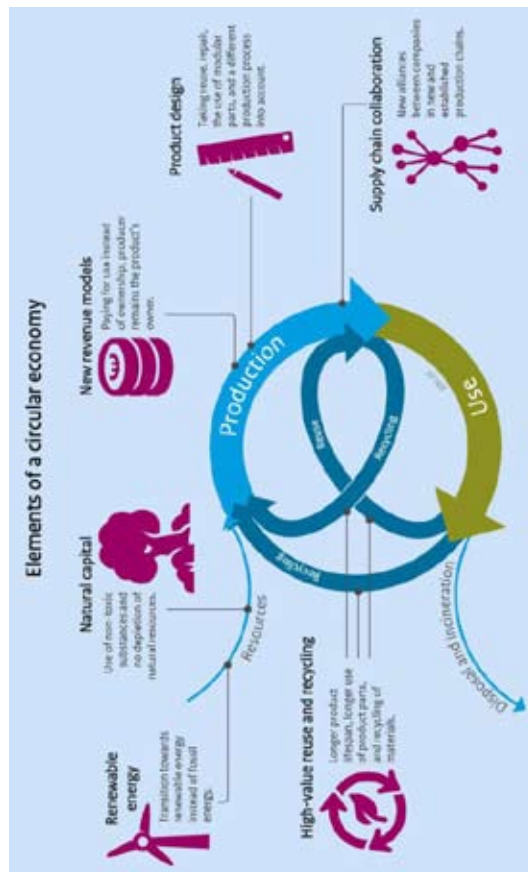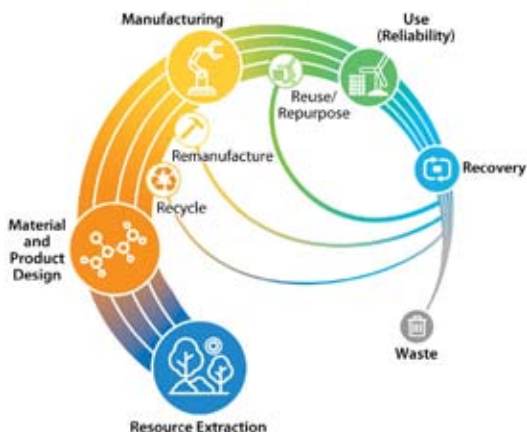

A circular economy is a system that emphasizes an environmentally sustainable approach where product materials follow a cycle of being consumed, reused, recycled, and redesigned for another cycle of use. Circular economies feature sound (EPR) practices for end-of-life products.

Initiating effective extended producer responsibility (EPR) programs will be key in disposing environmentally hazardous products such as white goods. **MOPIA** is eager to include white goods in a Made in Manitoba EPR solution.

# STAY INFORMED AND REDUCE OUR ENVIRONMENTAL FOOTPRINT



## WITH MOPIA'S MONTHLY BULLETIN



# PART OF MANITOBA'S CLIMATE CHANGE SOLUTION

- Internationally Recognized
- Self Sustaining
- Unique & Visionary

MOPIA's collaborative approach in spearheading Manitoba's actions to tackle the challenges of ozone depletion and climate change has offered innovative solutions that are unique to the world. From training, stakeholder awareness to database and information management.

On the international stage, MOPIA is an active participant with a unique role. Having hosted made-in-Manitoba capacity building study tours with the United Nations (DTIE) to participating on the Halons Technical Options Committee and a World Bank Mission to China. MOPIA focuses locally engaging stakeholders with regulatory awareness, with Environment and Climate Change Canada and Manitoba Sustainable Development on ODS and climate change solutions, management and strategy.

## BE PART OF THE SOLUTION !! WWW.MOPIA.CA




MOPIA is aiming to go paperless.

Sign up for our bulletins and also get:

- Regulation Changes
- Enforcement / Compliance Information
- Industry News
- Climate and Ozone Updates
- Certification and Training options

VISIT [WWW.MOPIA.CA](http://WWW.MOPIA.CA)  
TO SEE THE LATEST ISSUES  
AND SIGN UP FOR EMAIL ALERTS.

Each month new climate variations take place around the world. Climate Change effects impact Manitoba's agriculture, First Nations/Indigenous communities, watersheds and forests. These will undoubtedly continue to intensify unless significant action is implemented to mitigate climate change. **NOAA** highlights these anomalies on their website with their **Global Climate Report**.

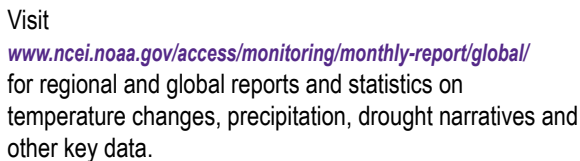

**MOPIA@MOPIA.CA • WWW.MOPIA.CA**



**IF YOU HAVE ANY INFORMATION TO SHARE THAT YOU THINK MAY BE USEFUL TO OTHERS, PLEASE CONTACT MOPIA. WE MAY BE ABLE TO PUBLISH YOUR INFORMATION IN ONE OF OUR MONTHLY BULLETINS, POST ON OUR WEBSITE OR IN A FUTURE COMPLIANCE GUIDE.**