

TENTH EDITION

THIS DOCUMENT IS UPDATED CONTINUOUSLY,
AND IS AVAILABLE AT MOPIA.CA

MANITOBA COMPLIANCE GUIDE

OZONE DEPLETING SUBSTANCES
& OTHER HALOCARBONS

FOR HVAC, REFRIGERATION, A/C, AND FIRE SUPPRESSION SECTORS



MOPIA'S MANITOBA COMPLIANCE GUIDE

**AN INNOVATIVE MANITOBA
NON-GOVERNMENT ORGANIZATION (NGO)
IN COLLABORATION WITH THE PRIVATE
SECTOR, MANITOBA GOVERNMENT AND
OTHER LEADING STAKEHOLDERS**

HERE TO ASSIST!

MOPIA is here to assist you in your transition of phasing-out, eliminating or properly managing the stewardship of various Ozone Depleting Substances (ODSs) and halocarbons including such synthetic gases as CFCs, HCFCs, HFCs, HFOs, halons and other substitutes or alternatives in your possession at your workplace, in the course of your employment, business and throughout the environment.

We encourage you to contact **MOPIA** if you require information on Manitoba's unique stratospheric ozone and climate protection program. Also, if you need assistance or clarification on some of the information in this guide, a speaker at one of your events, information on ozone depletion, sun awareness, climate change or industry practices.

Also, how can we improve our program or future compliance guides? Let us know what's missing or suggest what should be added.

MOPIA is looking to make this guide and future info pieces as useful and comprehensive as possible

MOPIA

1082 Main Street, Winnipeg, Manitoba, Canada R2W 5J3

Phone: 204.338.2222 • Toll Free: 888.667.4203

Fax: 204.338.0810

Email: mopia@mopia.ca / mopia@mymts.net

Website: www.mopia.ca

You are welcome to duplicate, share or quote information within **MOPIA's** Compliance Guide. However, some material is sourced from other organizations and so where appropriate, we ask that you provide a reference or an appropriate credit.



MOPIA.CA

STRIVING TO BE ACCURATE (DISCLAIMER)

MOPIA's Compliance Guide was prepared for your information and to help you comply with the **Manitoba Ozone Depleting Substances and Other Halocarbons Regulation 103/94**. However, this Compliance Guide and the federal Code of Practice do not replace any Act or Regulation and have no legal force themselves. The appropriate legislation must be referred for all purposes of interpretation and application of the law. The responsibility falls on the users of this guide to ensure that they comply with all applicable legislation. **MOPIA** takes no responsibility for any errors or omissions.

This guide provides general information and a summary of the *Manitoba Ozone Depleting Substances Act* and the *Regulation* only. Always refer to the actual legislative text.

The complete provisions dealing with the use of regulated refrigerants (and halons) are contained in the *Ozone Depleting Substances Act* (Chapter 080) and the accompanying *Ozone Depleting Substances and Other Halocarbons Regulation 103/94*. Copies of the legislation and information on other ozone depleting substances not covered may be obtained from **MOPIA** or the Government of Manitoba website:
web2.gov.mb.ca/laws/index.php

Note that the certificate course is in no way to be construed as certification or a license of competency to repair / service refrigeration and air conditioning or fire suppression equipment. The certification only demonstrates accreditation in understanding provincial legislation (*Manitoba Ozone Depleting Substances Act and Regulation*) and environmental awareness.

CONTENTS

Introduction	6
A Note from MOPIA's Executive Director	9
What are ODSs?	12
Universal Ratification	15
Alternatives / Replacements	20
The Manitoba ODS Act	21
Penalties Under the Act	22
Manitoba's Regulation	23
Key Responsibilities of Service Technicians	24
Key Responsibilities of Service Companies	27
Foams	37
The Automotive Sector	38
CFC Chiller Phase Out	40
Halon Specifics	41
Record Keeping	42
Federal Legislation	43
White Goods	44
Common Questions & Answers	45
Appendices	55
Ozone in the Atmosphere	55
Ozone Depleting & Global Warming Potential	56
Sample Products containing CFCs, HCFCs & HFCs	57
Canadian Phase-Out	58
Federal Halocarbons Regulations	60
Switch the Stat Program	60
Climate Change	61
ODS Record Data Sheet	62
Refrigerant Stewardship	63
Approved Leak Testing	64
Certification Training	68
Industry and Public Outreach	70
MOPIA's Corporate Structure	75
Environment Officers' Contact Information	77
Proposal to Phase Out HFCs	78
EPA's SNAP Program	79
Enforcement & Penalties	79

AWARD WINNING

- *Innovative*
- *Experienced*
- *Resourceful*



MOPIA was awarded the Provincial Sustainability Award by former Premier Gary Filmon in the 1990's. **MOPIA** went on to be nominated for the US EPA Stratospheric Award and others.

Pictured are former Chairs Bob Stark, Dawn Turner and Mark Miller (Executive Director).



Mr. Shende, John Kub, & Mark Miller in Dubai at the 27th MOP (2015)



Mr. Chasserot (shecco.com), Mark Miller & Brent Hoare (greencooling.com) in Brussels at ATMOSphere Conference




Mrs. Skorodenski & Mark Miller at the 25th MOP in Bangkok (2013)



Mr. Ralph Avallone (greenenergycouncil.com) & Mark Miller at Earth Day / Climate Change Conference

EMERGING FACTS & STATS

In 2016, global surface temps were the warmest since records began in 1880.

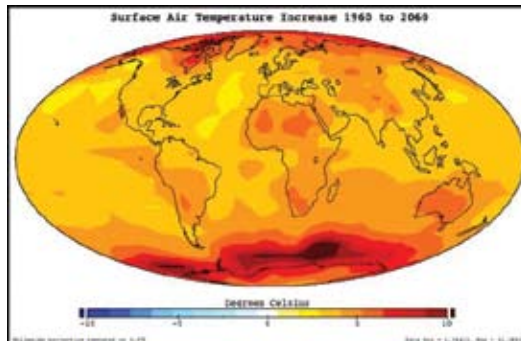

See: www.noaa.gov/climate

ACTION BY MANITOBA



The Manitoba Government is consulting with Manitobans on how best to tackle the many challenges of climate change.

See: www.gov.mb.ca/sd/climate

Left: Minister of Sustainable Development the Honourable Rochelle Squires



INTRODUCTION

MOPIA's Regulatory Compliance Guide was developed originally in 1993 and updated several times including most recently in 2017. It is specifically designed to assist those in the refrigeration & air conditioning fields (HVAC/R), as those sectors include the most stakeholders and regulatory requirements. However, this guide may also be useful for those using "other" regulated substances used as fire extinguishing agents (halons), foams, solvents and propellants. It is also handy for the general public for use as an information tool regarding regulated products and industries' regulatory responsibilities.

MOPIA: Successful and Self-Sustaining

The **Manitoba Ozone Protection Industry Association Incorporated (MOPIA)** was created in October 1993 by a group of committed individuals from various associations (industry and environmental), companies, groups and government institutions to address ozone and climate challenges.

MOPIA is a not-for-profit, non-governmental organization that has been appointed under Manitoba's Regulation 103/94 to administer components of the Regulation to provide certification training, receive ODS records, leak reports, certificate renewals, public and industry support and/or information. **MOPIA** will endeavor to provide information and the necessary infrastructure for industry and the public to comply with Manitoba's Regulation and innovative atmosphere and climate protection programs.

Since 1994, **MOPIA** has succeeded through the efforts of volunteers from across the province representing stakeholders including refrigeration & air conditioning, halons (fire extinguishing agents),

sterilants, solvents and foams, environment & union groups, educational institutions and government liaisons. **MOPIA** has an elected Executive, Board of Directors and a full-time Executive Director and staff. The association is a non-exclusionary coalition of representatives that welcomes direct participation through a nominal annual membership fee. We are non-partisan and have no direct political affiliation.

Active Outreach

MOPIA participates in various local, provincial and national and international outreach initiatives. Each spring and summer, **MOPIA** hosts a series of provincial compliance awareness sessions for stakeholders.

MOPIA is also active on the national and international level. We were an endorsing agency to the International Conference on Climate Change and CFC Alternatives held during the 1990s. **MOPIA** also attends most United Nations Ozone Secretariat Montreal Protocol Meetings (MOP) and sessions pertinent to our stakeholders hosted by Environment and Climate Change Canada (ECCC) and others such as Shecco, RMC, and UN agencies.

MOPIA continues to host open and transparent Annual General Meetings to ensure our stakeholders are informed and involved with our initiatives

MOPIA has also collaborated with UNEP DTIE and the global community by hosting international capacity building study tours to Manitoba. We continue to liaise and dialogue with innovators and developing nations around the world.

MOPIA has continued to respond and progress to the needs of our stakeholders. New and innovative approaches to outreach, including consumer, public and industry awareness continue to be initiated.

Continuing industry compliance awareness promotions are developed to inform the media and public of the importance of the efforts of our stakeholders efforts and those of **MOPIA**.

Let us know if you have any suggestions to make Manitoba's atmosphere protection program among the best in the World!

MOPIA'S MISSION

To provide information and assistance (the leadership, administrative and technical support) to all stakeholders in an effort to uniformly phase-out and eliminate the use of ozone depleting substances in the Province of Manitoba.



Meghan Skorodenski & Michael Blackey in Paris at UNESCO and the 26th MOP (2014)



George Kurowski (Instructor - Refrigeration & Air Conditioning) at Red River College - Winnipeg



Michael Blackey, Ms. Samira Korban-de Gobert (editor-OzoNews) & Mark Miller



Meghan Skordenski, Michael Blackey, Stephen O. Andersen & Mark Miller in Geneva at the 24th MOP (2012)

A NOTE FROM MOPIA'S EXECUTIVE DIRECTOR

I have seen a lot of progress and positive achievements through the implementation of The Montreal Protocol over the past 20+ years! Many challenges still remain including such things as stopping the illegal trade (the black market) of regulated products, the harmony in standards/regulations across the globe and certainly further controls to safeguard the planets fragile ecosystem in view of a growing population and all the aspects tied with economic prosperity. Food, water and social security being primary.



Manitoba is a leader on many of these fronts. Ozone and climate protection strategies must continue to be a serious priority for all levels of government. From the emergence and embracing of clean energy and technologies, our world will be inevitably challenged with changing political and corporate dynamics. Our world in 2030 will be much different than today (2017), with many more climate refugees, possible food and water shortages and pressures of geopolitical forces and international terrorism (biological warfare agents and the like).

In Canada, both the federal and provincial governments will need to implement new regulatory amendments to control and restrict the use of HFCs with the passing of the Kilgali Agreement at the 28th Meeting of the Parties (2016). This is a significant step forward to protect the climate system. It will also mean the introduction of new refrigerants, and other gases, technologies and methods to handle these alternatives.

MOPIA will strive hard to keep aware and on the leading edge for our stakeholders – knowledgeable about emerging technology and regulatory strategies via our broad international liaisons. Our training will continue to be second to none and we aim to achieve many more successes. **MOPIA** has done many innovative projects and with your input we will continue to be among the most efficient, informative and creative NGOs in the world for the benefit of our stakeholders and the earth's environment!

My best regards,


Mark Miller

MOPIA'S (EXCOM) EXECUTIVE COMMITTEE



John Kubilanski
Chair of the Board of Directors



Michael Blackey
Vice-Chair



Bill Grywinski
Treasurer



Meghan Skorodenski
Secretary



Don Thompson
Member-at-large



Mark Miller
Executive Director

MOPIA'S BOARD OF DIRECTORS

Members of **MOPIA's** Board are professionals with a wealth of expertise, ranging from positions as educators, manufacturers, managers, service technicians, administrators, and senior government officials. Their knowledge and breadth of experience fosters **MOPIA's** unique leadership role.



George Kurowski



Kirk Esau



Botho Kramer



Laverne Dalglish



Jeff Hillock



Kent Cielen

YOU

You too could
be a member
of our board.
Contact **MOPIA**
for details.

WHAT ARE ODSs?

ODSs also include Halocarbons (HFCs)

Ozone depleting substances (ODSs) may commonly include air conditioning & refrigerant gases, halons, cleaning solvents, foam cushioning and insulation products, fumigants and sterilants. ODSs are also used in a variety of other applications such as an additive to make another substance or other products. In some instances, Classes of ODSs have been banned for use. An example of this is Class 1 ODS used as an aerosol product carrier and in food containers. See page 57 of this guide for a list of some products that may contain and / or use ODSs.

Refrigeration and air conditioning systems are closed loops. This means that the refrigerant is contained within the sealed system of the unit. However, if the refrigerant escapes, this substance (gas) may ascend 15 – 40 kilometres above the earth and reaches through the ozone layer (nature's protective umbrella). At this point, the ODS molecule is broken down by the ultraviolet radiation from the sun. This occurs since the ozone layer is no longer able to protect the CFC or HCFC molecule from the full impact of the sun's ultraviolet radiation. Furthermore, this causes the chlorine atom to break off and start destroying ozone. Each chlorine atom can destroy up to 100,000 ozone molecules before being washed out of the sky sometimes with rain. Scientists believe that it may take between 40-100 years for the atmosphere to thoroughly cleanse itself of chlorine containing chemicals.

Chlorofluorocarbons (CFCs) are extremely stable synthetic chemical compounds that have existed since the early 1930's. They were first developed as refrigerants for refrigerators and air conditioners. In

the manufacture of foams, for such things as construction materials, drinking cups and furniture cushions. Other uses for CFCs were found in chlorinated cleaning solvents used to degrease metals or clean electrical circuit boards. Aerosol sprays and hospital sterilization applications also used CFC products.

Hydrochlorofluorocarbons (HCFCs) are less stable, not as damaging to the ozone layer and therefore more environmentally friendly than CFCs. Their use as a refrigerant should be viewed as a short term alternative and they should be looked upon as a bridging compound only.

HFCs are also regulated and controlled substances in Manitoba. They do not contribute to ozone depletion but do have global warming characteristics and as such must be handled in the same safe manner as earlier generation refrigerants including CFCs and HCFCs. The Kigali Agreement of the Montreal Protocol now includes HFCs which will mandate their eventual phase-out of production and use by Nations. Canada is already proposing use restrictions (see www.gazette.gc.ca/rp-pr/p1/2016/2016-11-26/html/reg1-eng.php). At present, a new generation of substances (HFOs) is appearing within the marketplace and these are not currently regulated but we recommend they be handled responsibly as they may become regulated and it's always best to recovery and reuse than emit to the atmosphere.

Halons are chemicals that are used primarily for fire protection in aviation and by the military. They contain a chemical called bromine, which destroys the ozone layer. In fact, the potential of halons for destruction of the ozone layer is much greater than that of the most common CFCs.

NATURAL REFRIGERANTS

Natural refrigerants are a variety of gases that are typically less harmful to the environment than HCFCs and HFCs. They have little global warming potential (GWP). They include carbon dioxide, ammonia and hydrocarbons (propane / butane).

Check out these sites for more information:

www.hydrocarbons21.com

www.ausref.org.au

www.r744.com

United Nations Framework Convention
on Climate Change:

www.unfccc.org

Google search more with the terms:

- Natural Refrigerants
- Alternative Refrigerants



Kirk Esau (MOPIA board member) at Red River College
HVAC/R shop, viewing new refrigerant line gauges

UNIVERSAL RATIFICATION

ACTION TO PROTECT THE OZONE LAYER

The Montreal Protocol

The Montreal Protocol is the world's most successful environmental treaty to address policies and control substances that cause harm to the environment and human health. This was initiated in response to the growing scientific consensus that ODS's and halons would ultimately deplete the ozone layer. In 1981, the United Nations Environment Program (UNEP) began negotiations to develop multilateral protection of the stratospheric ozone layer. In March 1985, these negotiations resulted in the Vienna Convention for the Protection of the Ozone Layer. The Convention provided a framework for international cooperation in research, environmental monitoring and information exchange.

Back in September 1987, 24 nations, including the United States, Canada, Japan, the Soviet Union, the European Community (EC) and country members of the EC, signed the Montreal Protocol on Substances that Deplete the Ozone Layer. The Montreal Protocol entered into force on January 1, 1989. The Protocol also contains the requirement of technical and scientific assessments, to be undertaken at least every four years. Today, **197** nations, all UN-recognized countries in the world, have ratified The Montreal Protocol.

Shortly after the 1987 Protocol was negotiated, new scientific evidence conclusively linked CFCs to depletion of the ozone layer and confirmed that depletion had already occurred. Consequently, many countries called for further actions to protect the ozone layer by expanding and strengthening the original control provisions of the Montreal Protocol.

There have been successive Amendments to the Montreal Protocol since its inception and these can all be seen at: www.ozone.unep.org

MOPIA has been an active NGO participant in many Montreal Protocol meetings, including most recently in Montreal, at the 29th meeting of the Parties (2017).

Control of Ozone Depleting Substances in Manitoba

In Manitoba, the control and use of ODSs is governed by the **Manitoba Ozone Depleting Substances and Other Halocarbons Act and Regulation**. In addition, the Government of Canada (Environment and Climate Change Canada) has regulations dealing with the import, export, manufacture, use and sale of numerous ODSs. Other Canadian provinces also have separate regulations governing ODSs and their substitutes. For the transportation of an ODS, provincial and/or federal legislation relating to the transportation of dangerous goods applies. Contact Transport Canada. In addition, certain associations (i.e. Canadian Standards Association, Underwriters Laboratory) have the responsibility to approve proper equipment (recovery units, tanks, weights or scales). It should be noted that other government departments may have policies or regulations governing ODS's and their substitutes or alternatives.

Today, it is known that the use of various originally controlled substances have been reduced or entirely eliminated. These include most CFCs and halons.

Manitoba was the first province to implement mandatory certification training in Canada back in 1992. To date, some 14,000 technicians have participated in the training that provided information to individuals about regulation responsibilities and environmental awareness. It is not a trade license.

Manitoba's Leadership Role

Manitoba also initiated the most innovative and successful model for stakeholder participation, through the creation of **MOPIA**. In fact, **MOPIA** is being recognized widely as a practical and cost effective model to facilitate compliance of government regulation. **MOPIA** has a dynamic collaboration & consultation approach that encourages the most directly affected and knowledgeable to participate.

Manitoba's initiative is in harmony with the National Action Plan for the Recovery, Recycling and Reclamation of Chlorofluorocarbons. This was developed by the Federal and Provincial Governments to support Canada's commitments under the "Montreal Protocol". Manitoba's initiative is also consistent with *The Environmental Code of Practice for the Elimination of Fluorocarbon Emissions from Refrigeration and Air Conditioning Systems* (2015) adopted by Environment and Climate Change Canada. The prescribed timetables and sections in the Act and the Regulation are a result of direct and extensive consultation with industry and other stakeholders.

Since January 1996, no new CFCs have been manufactured or imported in Canada. This means if there are CFC containing products to be repaired after that date, only recycled and reclaimed refrigerant will be available, and only for white goods as a refill ban is in effect for all other equipment. Therefore, we must conserve and prepare for the new ODS technologies. To this end, we should practice the following four R's:



**Reuse
Recycle
Recover
Reclaim**

CANADA & CLIMATE CHANGE

The Paris Agreement

On April 22, 2016
Canada signed onto
The Paris Agreement on
Climate Change.
194 countries are participating.
Visit: www.unfccc.int



Refrigerant Stewardship & Destruction of Surplus and/or Contaminated Refrigerants

Many wholesalers of refrigerants across Canada are part of a national initiative to receive, back used, cocktailed or surplus refrigerants from the stationary A/C and HVAC sectors. These refrigerants are then sent to RMC (Toronto) for processing and possible final destruction at plants designated to carry out this work (located in Alberta, Illinois and Texas).



For more information, visit:

www.refrigerantmanagement.ca

Note that the mobile and white goods sectors are not yet included in the national refrigerant responsible care program.

Refrigerants from these sectors need to be stored or disposed of properly.

THE MONTREAL PROTOCOL CONTROLS ON VARIOUS ODSs

Montreal Protocol control measures		
Summary of Montreal Protocol control measures	Developed countries	Developing countries
Ozone depleting substances		
Chlorofluorocarbons (CFCs)	Phased out end of 1995a	Total phase out by 2010
Halons	Phased out end of 1993	Total phase out by 2010
CCl ₄ (Carbon tetrachloride)	Phased out end of 1995a	Total phase out by 2010
CH ₃ CCl ₃ (Methyl chloroform)	Phased out end of 1995a	Total phase out by 2015
Hydrochlorofluorocarbons (HCFCs)	Freeze from beginning of 1996b 35% reduction by 2004 75% reduction by 2010 90% reduction by 2015 Total phase out by 2020c	Freeze in 2013 at a base level calculated as the average of 2009 and 2010 consumption levels 10% reduction by 2015 35% reduction by 2020 67.5% reduction by 2025 Total phase out by 2030d
Hydrobromofluorocarbons (HBFCs)	Phased out end of 1995	Phased out end of 1995
Methyl bromide (CH ₃ Br) (horticultural uses)	Freeze in 1995 at 1991 base level 25% reduction by 1999 50% reduction by 2001 70% reduction by 2003 Total phase out by 2005	Freeze in 2002 at average 1995-1998 base level 20% reduction by 2005 Total phase out by 2015
Bromochloromethane (CH ₂ BrCl)	Phase out by 2002	Phase out by 2002

a With the exception of a very small number of internationally agreed essential uses that are considered critical to human health and/or laboratory and analytical procedures.

b Based on 1989 HCFC consumption with an extra allowance (ODP weighted) equal to 2.8% of 1989 CFC consumption.

c Up to 0.5% of base level consumption can be used until 2030 for servicing existing equipment, subject to review in 2015.

d Up to 2.5% of base level consumption can be used until 2040 for servicing existing equipment, subject to review in 2025.

e All reductions include an exemption for pre-shipment and quarantine uses.

Notes:

1. The timetable set by the Montreal Protocol applies to bulk consumption of ozone depleting substances. Consumption is defined as the quantities manufactured plus imported, less those quantities exported in any given year. Percentage reductions relate to the designated 'base year' for the substance. The Protocol does not forbid the use of existing or recycled controlled substances beyond the phase out dates.

2. Further information on these ODSs can be seen in the United Nations Environment Programme Ozone Secretariat's Handbook for the International Treaties for the Protection of the Ozone Layer (See Section 1.2 for links to graphs displaying ODSs phase out timetables).



Visit the Ozone Secretariat for the latest Montreal Protocol text and any amendments at:

ozone.unep.org/new_site/en/montreal_protocol.php

ALTERNATIVES AND/OR REPLACEMENTS

ODS REPLACEMENTS AND/OR ALTERNATIVE SUBSTANCES

Globally, the manufacture of class 1 CFCs has been eliminated, and the use and production of HCFCs continues to be reduced. In Manitoba, alternative refrigerants and ODS substitutes have become widely available. These primarily include HFCs, HFOs, ammonia, carbon dioxide and hydrocarbons. Recognized alternatives are published periodically by the U.S. Environmental Protection Agency (EPA) under their SNAP Program. **MOPIA** does not endorse the use of any particular product or company. We encourage the use of energy efficient, safe and environmentally friendly products.

Also check with original equipment manufacturers (OEMs) on their use specifications, insurance agencies on their stipulations (i.e. MPI) and their position/policy on the use of a product/gas and the various standard organizations including the Fire Commissioner, Canadian Standards Association, ASHRAE, Transport Canada and others.

MOPIA encourages individuals to investigate and source alternative/substitute substances, taking note that certain substances have global warming potential (GWP) and/or may have health exposure limits for humans. Always read a substances Material Safety Data Sheet (MSDS) prior to use. Your local wholesaler or product agent is probably the best source for information.

NOTE: “Drop-in” replacements should be used cautiously (according to manufacturer specifications where available), and must not be added to a system if a different refrigerant is in the system. This must be properly recovered first. See **MOPIA's** “Don’t D.I.Y.” poster online (page 74).

THE MANITOBA ODS ACT

THE OZONE-DEPLETING SUBSTANCES ACT (highlights)

The Ozone Depleting Substances Act (C.C.S.M. c.080) was given Royal Assent on March 8, 1990 and was proclaimed into force on July 1, 1992.

The Act acknowledges that the escape of ozone depleting substances is harmful to public health and the natural environment by destroying ozone in the upper atmosphere.

The objective of the Act is to reduce and eventually eliminate the release of ozone depleting substances into the atmosphere. The Act applies to substances that are designated as “ozone depleting substances” within the Act itself or by the Regulation. Specific requirements are defined by the Regulations under the authority of this Act.

Enforcement of the Act and the Regulation

Environment officers employed by Manitoba Sustainable Development are responsible for enforcement of the Act and Regulation, **not MOPIA personnel**. Any tips of abuse, misuse or actions contravening the Regulation may be reported to Manitoba Sustainable Development (204.945.7100, or ods@gov.mb.ca) for follow up and / or investigation.

Who to Contact at the Province

See page 77 for Government Contact Information, or visit: www.gov.mb.ca/sd/ece/contact

PENALTIES UNDER THE ACT

Offenses and penalties **Section 8 (Act)**

Persons or companies found in non-compliance with any provisions of the Regulation are liable to prosecution. It should be noted that Manitoba has among the highest notarized fines in the Act among all Parties to the Montreal Protocol.

Non-compliance under The Act allows for penalties of up to \$100,000 and/or 6 months in prison for individuals and \$1,000,000 for companies.

Offenses and penalties: corporations **Section 8 (Act)**

In the case of a second or subsequent offense, to a fine not exceeding \$1,000,000, and for each day or part of a day that the offense continues after the day in respect of which the corporation is first charged with the offense, the corporation is liable to a fine not exceeding \$10,000.

Other penalties **Section 8 (Act)**

3. A judge may, in addition to a fine or other penalty under subsection (1) or (2), require a convicted person
 - a. to pay, as an additional fine, compensation for damages or to make restitution to a person who suffers loss or damage as a consequence of the commission of the offense, in such amount as the judge considers appropriate;
 - b. to pay, as an additional fine, an amount that represents the monetary benefit that is acquired by, or accrues to, the convicted person as a result of the commission of the offense.

MANITOBA'S REGULATION



The *Manitoba Ozone Depleting Substances and Other Halocarbons Regulation 103/94* (the ODS Regulation) came into effect on May 27, 1994. It provides detail to the guidelines specified in the Act. In broad terms, the Regulation further defines the Act

by providing details of handling regulated products.

PROCESS FOR CHANGE

Since **MOPIA's** inception in 1993, **MOPIA** has been working proactively with representatives from both provincial and federal governments and our stakeholders to ensure our Regulation is current and relevant. **MOPIA** continues to keep engaged and atune to various regulatory strategies and new technologies in other locations, including outside North America.

Stakeholder comments are always encouraged on ways to ensure a fair and level playing field for those affected by the regulatory framework. Each Spring since 2008, **MOPIA** has been hosting outreach and program awareness sessions across Manitoba. These events have assisted us to directly understand each regions unique needs and help consolidate ideas for potential (future) regulatory amendment recommendations.

Outreach sessions are held on an annual basis during May – September. Watch our website for details at www.mopia.ca

Administrative Assistance

In 1994, the Manitoba Government appointed **MOPIA** to assist in delivering components of the Regulation. **MOPIA** works with those with a direct interest, to assist industry and the public, and move towards reducing & eliminating ODS consumption in Manitoba.

KEY RESPONSIBILITIES FOR SERVICE TECHNICIANS

MOPIA has chosen to highlight selected regulatory responsibilities under Manitoba's Regulation 103/94 in this Compliance Guide. This guide does not include or highlight all regulatory responsibilities. You should navigate the entire Regulation to ensure you have a complete understanding of your requirements. Please review the following and consult the actual text if necessary to best ensure you understand what is legally required in the handling of regulated products.

1) Annual Renewal of Technician Certification

All service technicians must renew their certification annually by June 1 of each year through **MOPIA**. This may be done with payment of the annual fee in-person at **MOPIA**, by return mail, fax, over the phone, or online at www.mopia.ca (by credit card).

MOPIA sends renewal reminders to all 5,000+ technicians one month in advance of the June 1 due date via mail and in future we plan to via email to reduce our environmental footprint.

2) Record Data Sheets

Technicians & companies must mail, fax or email copies of their record data sheets once per year by February 1st to **MOPIA**. The records should document the use of regulated substances for the period January 1 to December 31 of the previous year. Even if you have not used any regulated refrigerant or halon during the year, we need to record this within our database. Be sure to let **MOPIA** know your name and Certification Number or you may be "flagged" for possible investigation for not submitting records.

3) Reporting of all leaks (intentional or not) over 22 lbs / 10 kgs

The technician working on a system containing a refrigerant gas (or halon) who discovers a leak must report the leak, both in their annual services records, but if over 22 lbs. to Manitoba Sustainable Development immediately (same day of the incident or discovery).

For those that do not comply, charges may be served by an Environment Officer. A one-page leak report form (as shown below) must be completed and faxed in to the Manitoba Government (Sustainable Development), or sent electronically to ods@gov.mb.ca. **MOPIA's** website has a copy of this form, or call **MOPIA** to email or fax a Leak Report Form to you.

Call 204.945.7100. Rural residents call 1.800.282.8069 extension 7100.

OZONE DEPLETING SUBSTANCES (ODS) AND OTHER HALOCARBONS LEAK REPORT FORM		
		
<small>Under Section 24 of the Manitoba Ozone Depleting Substances and Other Halocarbons Regulation (103/94), a person who owns, services, installs or repairs equipment from which there has been a release of regulated a Class 1, 2 or 3 substance, accidental or not, of more than 10 kgs or 22 lbs into the environment shall immediately (within 48 hours) report the incident. Report the incident by faxing the completed information on this form to the Department of Sustainable Development at 204-945-2338.</small>		
RELEASE REPORTED BY: PLEASE COMPLETE ALL INFORMATION REQUESTED:		
Company	Phone	Fax
Service Technician Name	Manitoba Certification Number (MBN)	
Company Address		
Signature	E-mail	
ODS and OTHER HALOCARBON RELEASE INFORMATION		
Date Leak Reported	Recorded by	
Release Address		
Equipment Type		
Type of ODS or Other Halocarbon Released	Quantity Lost	Quantity Recharged
Leak Located	Yes	No
Leak Location		
Date of Leak		
Probable Cause of Leak		
Repairs Completed or to be Undertaken		
<small>I declare that the contents of this report are true and accurate and understand that providing false information may result in prosecution under the law.</small>		
		Signature:
<small>No notification of receipt of leak report will follow. Inquiries may be directed to Manitoba Sustainable Development information line at 204-945-7100 or ods@gov.mb.ca</small>		
<small>FOR OFFICE USE ONLY</small>		
Date Received:		Document 120902

4) Leak Test Requirements

Section 12 of the Regulation

1. No person shall recharge or top-up equipment that contains a Class 1, 2 or 3 substance unless the person first
 - a. conducts a leak test in accordance with the procedure approved by the Minister; and
 - b. if the leak test reveals a leak, repair the leak so that the leaking can no longer occur

See page 64 in the Appendices of this Guide for the approved procedure.

The approved leak testing methods are available from **MOPIA**. It is still mandatory to use a technique that does not allow for the venting of any refrigerant (i.e. ODS refrigerants must not be added to test for leaks).

OZONE & CLIMATE FACT

Human activities are adding approximately 70 billion tonnes of carbon to the Earth's atmosphere each year. Oceans and lands absorb about half that amount, while the rest stay in the atmosphere for about 100 years.

In 2014, Canadians were responsible for 20.6 tonnes of CO₂ equivalent emissions. This is three times Switzerland's per capita emissions of greenhouse gases.

www.climatechangeconnection.org

www.climate.nasa.gov

www.ncdc.noaa.gov/sotc/

www.sciencedaily.com

KEY RESPONSIBILITIES FOR COMPANIES

Certification & Training Required for those working with Halons


Individuals and/or companies who service, recharge or repair fire protection equipment (containing halons) will need to be trained & certified. **MOPIA** administers the halon training module. Halons are restricted for use in very limited applications.

Purchasing Regulated Parts / Refrigerants

To purchase components or substances in the regulation, you must be certified or maintain a secondary distributor permit.

OZONE & CLIMATE FACT

HCFCs & HFCs contribute significantly to effects on our atmosphere dynamics. In fact, some HFCs contribute thousands of times greater to climate change than carbon dioxide. It has been projected that HFCs could contribute upwards of 30% of all GHGs by 2050, if not controlled under the Montreal Protocol.

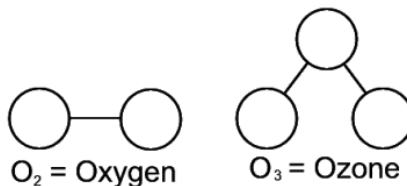

Secondary Distributor Permits / Numbers

Companies or shops who purchase regulated refrigerants (ODSs), parts or equipment containing an ODS may choose to apply for a secondary distributor permit. This allows the business to purchase and maintain ODS products under the company SD Permit rather than a technician's certificate. This generally applies to mid to larger size companies (3+ employees) who purchase regulated products and/or ODS components, or companies who purchase product for contracting out servicing to certified technicians.



Garages, repair shops, service stations and the like may apply to receive a secondary distributor permit number (SD#). The SD# will allow the employer (company) to purchase refrigerant and/or equipment rather than using a personal certification number.



Service By Trained Technician Section 6

No person other than a trained service technician shall install, repair or service air conditioning, refrigeration or other equipment containing a class 1, 2, or 3 substance.

- This applies to anyone who attaches gauges to the sealed system, recharge, service or repair an air conditioning system or refrigeration equipment but it will not apply to people who perform preventative maintenance such as changing filters or washing units. It does not apply to electronic or electrical personnel who are not working on the gas side of a unit.

Recovery of Ozone Depleting Substances Section 7

All regulated refrigerants (i.e. HCFCs, HFCs, etc) must be recovered and recorded and never vented. A service technician shall;

- a. have available at the job site operational equipment that can recover and contain an ozone depleting substance; and
 - b. recovers and recycles any ozone depleting substance that would otherwise be released during the procedure.
- “Available” means, recycling/reclamation equipment must be accessible at all times. For example if gauges are placed on a unit and refrigerant is going to be put into the unit, you must have a reclaiming on sight. Any time you have a tank of refrigerant at a unit/system you must have a reclaiming on-site! If you have a leak, according to The Federal Code of Practice (2015), you must make a permanent repair. If you had a leak and thorough leak testing shows no indication of a current leak, then you may replace the refrigerant.

- Each technician, who is on their own and is in the act of charging or recharging, must have a recovery vessel or recycler available, on-site.
- In the case of a large system, such as a food store with display cases, if you can isolate the component that is leaking that you found visually or by electronic means, you would follow this example:

- 1) *pump the unit down, to evacuate the component that was leaking*
- 2) *recover the residue gas from the component*
- 3) *make the repair*
- 4) *pressure test the component that was repaired with dry nitrogen*
- 5) *pull down to 500 microns or less and hold 15 minutes or to manufacturer's specifications.*
- 6) *open the isolating valves and add refrigerant to the unit (as required)*
- 7) *record the appropriate paper work*

- In the case of an environmental emergency, call 204.944.4888 or 1.855.944.4888 (24 hours). An environmental emergency is any release or imminent release of a contaminant that may pose a risk to public health or the environment..

Repair and service records to be kept

Section 8

Every technician that works on the refrigerant side of a system must keep refrigerant records.

1. a person who installs, repairs, services, recharges or does any other work referred to in Section 8, on air conditioning, fire extinguishing or refrigeration equipment shall:

- a. make a record (log book, invoice, work order, customer's bill) setting out the following:
 - the type of repair or service provided
 - date and location
 - whether an ozone depleting substance was removed, recovered, charged or recharged
 - the type of ozone depleting substance that has been recovered or recharged into the system
- b. leave a copy of the record with the owner or operator of the equipment that has been serviced or repaired.
 - This means a thorough record (log book, invoice, work order or customer's bill), noting the specifics of each job, must be maintained. As well, a detailed receipt must be given to the customer Please note the example in the appendix-record data sheet and the receipt following.

Example of a customer receipt:

MOPIA A/C & Refrigeration	
1082 Main Street	
06/21/2018	
<i>Details: Residential A/C System</i>	
<ul style="list-style-type: none"> • unit found M.T. of refrigerant • unit leak checked (dry nitrogen) • leaking shredder valve repaired • unit leak checked (dry nitrogen) • evacuate & dehydrate system to 500 microns • critical charge dialed into unit • unit leak checked with soap or electronic means • 4 lbs. - 8 oz. HCFC-22 recharged into unit 	
Technician's Name	
MB 19761	

See Page 62 for an example of a Record Form

Use of ODS sterilant

Section 9

- ODS Sterilants are prohibited for use.

Use of ODS solvent

Section 10

- No person shall use a Class 1 substance to dissolve another substance for the purpose of commercial cleaning of electrical or electronic equipment.
- Since January 1, 1996, no person shall use a Class 1 substance to dissolve another substance for the purpose of cleaning any object or thing.

Flushing and testing

Section 11

1. No person shall add a Class 1, 2 or 3 substance to any equipment for
 - a. flushing or leak testing the equipment; or
 - b. testing fire extinguishing equipment.

Addition of contaminants prohibited

Section 14

- No foreign material, substance or waste is to be added, mixed or dissolved into a recovered ozone depleting substance. The addition of dye detection materials to show leaks in refrigeration systems is not considered a contaminant by most refrigerant manufacturers. The mixture of another refrigerant or other products to an existing refrigerant (cocktail) will not be accepted by refrigerant manufacturers for reclaiming and is a violation.

Disposal of equipment or refrigerant

Section 16

- All ODSs must be recovered or recycled from air conditioning, fire extinguishing or refrigeration equipment prior to their disposal. An ODS decommissioned label should be applied to the product. Contact **MOPIA** for details.

- All registered vehicles A/C in Manitoba sent through MPI are decommissioned formally.
- White goods must have their refrigerant recovered before scrapping. Some cities and municipalities offer or allow white goods disposal at their dumps (waste disposal grounds) free or for a fee. Contact your municipality for details.

Return of Class 1, 2 or 3 ODSs to sellers

Section 17

- Sellers of regulated substances must accept back product they sell from a certified technician. The intent is the wholesale will work with RMC or others to properly dispose of the product(s).

Sale of Class 1, 2 and 3 ODSs in containers or equipment

Section 19

- The sale, transfer or display of an ozone depleting substance and/or product may only be made to a trained service technician or secondary distributor. (Note: This also includes HCFCs, rooftop units, split systems and any other equipment that makes up or is attached to a closed refrigerant loop).
- Please note that you may only sell to individuals who have presented their certification card at the time of purchase or secondary distributors.
- It is highly discouraged to sell parts / refrigerant over the phone or internet unless you can guarantee the product will be used by that specific card holder or secondary distributor. The onus is on you to ensure the proper sale transaction and documentation has occurred. You must verify that numbers are valid. Contact **MOPIA** for details.

- White goods must have refrigerant recovered before being crushed / recycled. Municipal waste disposal grounds (local dumps) across Manitoba often accept, offer options or have conditions on accepting white goods. See municipal waste and links here:

www.gov.mb.ca/sd/mb_recycling

Certification of Technicians Section 20

MOPIA, Red River & Assiniboine Colleges, RSES and HRAI offer certification training for technicians handling regulated ODSs.

Certain trades are recognized in Manitoba and require additional apprenticeship credentials to work on HVAC/R or air conditioning systems, in addition to your **MOPIA** certification. For instance, anyone working with regulated ODSs require **MOPIA** certification in addition to their trade accreditation (where applicable).

1. The Minister may certify a person as a trained service technician if he/she has completed a course in the proper repair, recovery and recycling procedures including the recovery of ozone depleting substances. This is not a trade license. It only refers to training with regard to environmentally safe practice. Technicians are subject to trade certification requirements which may be under the authority of the Department of Labour Education and Training.
2. The Minister may issue certification numbers to persons who have successfully completed a recognized certification program which includes passing an examination. **MOPIA** offers one-day certification classes throughout Manitoba on an ongoing basis.



- Your wallet certification card (shown above) allows you to purchase regulated refrigerants and equipment / parts in Manitoba. Servicing, repairing, charging, recharging air conditioning, refrigeration and halon equipment may require trade designation, as per Manitoba Apprenticeship.
- Contact **MOPIA** if you require details on when, where and who offers recognized regulation and environmental awareness certification courses.

Labels required on equipment Section 25

MOPIA maintains a supply of recognized labels for your purchase. You may create similar labels yourself, as long as they are consistent to the standard.


New Equipment:

- All new air conditioning, refrigeration or fire extinguishing equipment must display a prominent and permanent label that indicates the type of gas contained. The labels found on most newer model domestic refrigerators, car air conditioners and commercial equipment are acceptable. They should include or be similar to the samples shown (A and B) on page 36.

Recharging:


- This requirement is intended for retrofits of existing units, when changing refrigerant gases, or built up systems that have no fixed label on them. Please take note of example on page 36 (see B):
- The required label must include the following:
 - a) type of refrigerant
 - b) date of recharging
 - c) name of person or business that performed the service

REQUIRED LABELS



A - WARNING LABEL

All A/C units operating with an ODS should have this affixed to the unit.



B - ODS-UNIT ID

All A/C units must have a label identifying the refrigerant type and quantity. If you are

retrofitting a unit with a different gas, ensure it has a new label. Any time a refrigerant is substituted, you must affix a new **ODS-UNIT ID** label on the unit.



C - REFRIGERANT RECOVERED DECLARATION

Use this label when the unit

has had the refrigerant recovered. This identifies it as empty and available for recycling, scrap or other purposes. These are commonly used on vehicle write-offs and white goods.

NOTE:

You may purchase labels from **MOPIA** or design and print them independently, as long as the information the label matches these samples.

Bus Stop with A/C in Dubai, UAE



FOAMS

Stakeholders should be aware that federal legislation and policies negotiated under The Montreal Protocol do affect the manufacture and importation of foams containing ODSs.

Remember, the actual Regulation 103/94 text should be consulted for any & all legal interpretations.



For more information, visit www.cufca.ca

OZONE & CLIMATE FACT

The number of people affected by natural disasters around the world is rising, and 60,000+ die each year as a result.

It is estimated there will be 200 million climate refugees by 2050. Canada accepts 300 thousand immigrants per year (2017),

Damages have risen from an estimated \$20 billion on average per year in the 1990s to about \$100 billion per year during 2000-10. This upward trend is expected to continue as a result of the rising concentration of people living in areas more exposed to natural disasters, and climate change.

www.imf.org

www.unisdr.org

www.ifrc.org

AUTOMOTIVE SECTOR

It is estimated that there are approximately 52,000 new vehicles on Manitoba streets & driveways in 2017. Approximately 80% of these vehicles have air conditioning.

See: www.statcan.gc.ca/tables-tableaux/sum-som/l01/cst01/trade36g-eng.htm

Prior to 1995, all vehicle air conditioning contained CFC-12 as the refrigerant. Today, you will more commonly find HFCs & HFO refrigerants in new vehicles. Automotive repair specialists will have to adapt to the new and changing refrigerants and systems.

Regular Maintenance: Never top-up a unit!

Manitoba has a severe climate, both in summer and winter. Most often due to this inherent weather and some manufacturer designs, certain automobile air conditioning systems require regular maintenance to reduce leaking or the potential for leaks. It is good advice to recommend that consumers place their air conditioning systems on a defrost mode at least once a month (or as recommended by the manufacturer) to reduce the risk of a leak.

Front seals and compressors have been noted as recommended areas to inspect. They are often components that take the burden of strain during our climate and our inherent pot hole seasons (spring & fall).

A Common Shop Scenario

If a consumer asks to have their air conditioner checked and you find a leak after recovering the remaining refrigerant, you should tell the consumer (point out the fault) and indicate the leak must (upon the consumers approval) be repaired permanently.

Also note that the compressor or other components of the A/C system may eventually fail if the unit / leak is not permanently repaired. If the consumer chooses not to have the leak repaired, do not add or replace any ODS refrigerant recovered prior to finding the leak. Otherwise, continued leaking will likely occur.

The consumer should be advised that to knowingly allow a regulated refrigerant to leak is in contravention to Manitoba's *ODS and Other Halocarbons Regulation* and that they must not use a hydrocarbon or other refrigerant to top-up the system as this is called a cocktail which is prohibited under the Regulation, as well.

Advise them that refrigerants released into the environment are harmful as they contribute to climate change and are harmful to human health. They must take immediate action to repair the leak at your shop or someone else's, but it must be done and duct tape isn't a permanent repair!

The Automotive Industries Association, Mobile Air Conditioning Society, Manitoba Motor Dealers Association and other consumer oriented "automotive" groups (such as the Canadian Automotive Association - CAA) are also sometimes good sources for further information regarding these issues.



CFC CHILLER PHASE-OUT

There should be no CFC-operating chillers in Manitoba as they should have been taken out of service or retrofitted with a CFC alternative by December 31, 2014.



OZONE & CLIMATE FACT

Ozone loss is much more significant over the Antarctic. This is due to the extreme cold temperatures over the South Pole. A frozen chemical cloud forms over the Antarctic due to this extreme cold and dramatically speeds up ozone destruction. Arctic air, on the other hand, is much warmer and fewer clouds form there.

Therefore ozone destruction is much more severe in the Antarctic region as compared to the Arctic.

www.epa.gov/ozone

www.ozone.unep.org

www.ozonelayer.noaa.gov

HALON REQUIREMENTS

Fire Extinguishing Agents

Halons are among the most damaging substances to the ozone layer. While Halons are no longer produced anywhere in the world and can not be imported into Canada, they remain in use in both the aviation and military sectors as well as areas identified under the Montreal Protocol as “Critical Use”. Halons continue to be used in certain other countries around the world. However, they must rely on recycled stocks of Halon. Halon use in Manitoba is now limited and restricted for very definite applications (i.e. aviation or military).

Manitoba was among the most innovative and progressive jurisdictions to address halons. **MOPIA's** provincial halon working group was instrumental in creating successful strategies to eliminate non-essential halon use throughout Manitoba. Manitoba developed specific and comprehensive certification training for the industry as well as, implemented halon use permits so we could identify and monitor all users of halon in our province. **MOPIA** was actively involved and participated on Environment Canada's Halon Working Group until its demise. Since 2001, Mr. Don Thomson, (a former **MOPIA** President and current board member) has actively participated as the Canadian Representative on the UNEP's Halon Technical Options Committee (HTOC).

Halons are no longer produced or imported into Canada. Certain other nations do use halons but their use is quickly diminishing.

See: www.ozone.unep.org/en/assessment-panels/technology-and-economic-assessment-panel

MANDATORY RECORD KEEPING

All servicing that involves the recovery and/or adding of an ODS requires record keeping on your record data sheet or a form provided by **MOPIA**. In essence, every ounce of an ODS should be accounted. In many instances, this may require weighing a bottle after every job. In other circumstances, recovery units or gauges are available to measure the amount of substance added or recovered.


There are several companies, computer programs and systems available for your record keeping use. **MOPIA** has available an Excel record sheet on our web site. However, you are free to choose or develop your own record system as long as it meets the requirements of the Regulation. It is suggested that you contact **MOPIA** prior to using a new form or system. **MOPIA** can review your record system to help ensure you are properly recording the required information.

You must submit a copy of your record data sheets once a year by February 1st to **MOPIA**. In addition, keep a copy of your records on file. Manitoba's Sustainable Development Ministry is working to ensure compliance. Those who do not submit records may be prosecuted.

Secondary Distributor record requirements

All shops that have been issued secondary distributor permits must maintain records. **MOPIA** provides each permit holder with a sample generic record form for their use. Indicate the type of unit you have purchased, quantity and sale information as specified in the Regulation. Records must be maintained for a period of 3 years from the date of a purchase / sale transaction.

FEDERAL LEGISLATION

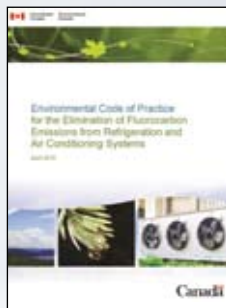

All federal government works and undertakings (i.e. rail, waterways, military, departments, first nations communities) are governed by The Federal Halocarbons Regulations, separate from any provincial regulations.

Information on the Federal requirements may be obtained from Environment and Climate Change Canada: www.ec.gc.ca/ozone/

MONTREAL PROTOCOL WHO'S WHO



UNEP DTIE Chief (retired) Mr. Rajendra Shende and MOPIA's Executive Director Mark Miller collaborated on a number of worthy international environmental initiatives over the past 20 years.

They are both notorized within UNEP's Montreal Protocol "Who's Who" Profile on Global Ozone Protection.
www.unep.fr/ozonaction/montrealprotocolwhoswho

WHITE GOODS



White goods (fridges, freezers, water coolers, window A/C, dehumidifiers, etc.) must have their ODS recovered prior to final disposal. Your local waste disposal ground likely accepts your white goods, but check with them first for fees and conditions.

Manitoba Hydro is seeking your old - but working - inefficient refrigerator (subject to change).

Check out Manitoba Hydro for any current refrigerator recycling (Power Smart) incentives at:

www.hydro.mb.ca/your_home/appliances_electronics/refrigerator_retirement



Manitoba's only comprehensive white goods recycling plant is located in Winnipeg. This plant extracts upwards of 95% of a unit's parts, including foam and refrigerants.

www.puresphera.com/en/

COMMON Q & A'S

What is the Code of Practice?

Environment and Climate Change Canada, in consultation with the provinces and stakeholders developed a Code of Practice (2015) that is useful for various industry sectors in guiding them in proper procedures for servicing or handling equipment in respect to the regulation(s). A new version was released in 2015. The Code is supplementary to the Regulation in Manitoba, but many provinces refer to The Code as regulatory - in other words it forms part of their regulatory approach.

Access the Code of Practice at:

www.ec.gc.ca/lcpe-cepa/default.asp?lang=En&n=D918C063-1

Are HFC 134a, 401a and similar refrigerants regulated or controlled?

Yes, HFCs including any refrigerant with a blend or mixture is regulated in Manitoba. These are Class 3 substances under Manitoba's *ODS and Other Halocarbons Regulation*.

Is HFO1234yf regulated in Manitoba?

No. Contact **MOPIA** regarding any recent amendments which may include new ODS alternatives or substitutes. In general, handle all products safely as if they were regulated and potentially dangerous to you and the environment.

Can a unit (i.e. car, fridge, freezer, air conditioner refrigeration unit) be topped up?

No! A service technician must first and always recover the remaining ODS, then check for leaks, permanently repair the leak and then they may replace the refrigerant with the recovered and/or virgin product.

How do individuals become certified?

In Manitoba, some community college programs include certification training. If not, and you require it, contact **MOPIA** for course info and enrollment specifications.

How do I become directly involved with MOPIA?

MOPIA is non-exclusionary. You may become as active as you wish by becoming a member. We will provide you with meeting notices and supplemental information to get you started. **MOPIA** is an International success story. Call 204.338.2222 for a membership application. Be part of the solution!

Who should I call to report a negligent act?

Manitoba Sustainable Development's Environment Officers follow-up on tips or issues of non-compliance. A list of the regional offices is on page 77 of the appendix.

Who can I sell ODS equipment / components to?

Only to certified technicians or secondary distributors. This includes items such as, compressors, refrigerant, coils, lines, etc, as indicated in the Regulation.

It says to report a leak over 10 kg in the Regulation, but to who and how "immediately"?

Reporting an ODS leak (unintentional/intentional) over 10 kgs/22 lbs. is mandatory. Whether you have come to a system or job site that has lost its charge or have accidentally damaged a line / component, leaks must be documented. Complete a Leak Report form and send to Manitoba Sustainable Development by fax (204.948.2338) or to ods@gov.mb.ca. Document the site details such as location, type of system, amount of ODS lost to atmosphere, cause of accident and what was done to stop any further leaking. Leaks over 22 lbs. should be reported within one day of the incident.

The leak was not my fault, I came to the system and it was empty or leaking (over 10 kgs / 22 lbs) Do I still have to report it?

Yes, whether intentional or not, you must report a loss of an ODS over 10 kgs. This does not automatically mean you will be charged. More importantly it means you are complying with the regulation. You must report these leaks by calling 204.945.7100.

What do I do with my old fridge, freezer or old car I wish to dispose?

You must ensure the ODS (refrigerant) has been recovered before scrapping or in some cases selling (i.e. for scrap). Some municipalities in Manitoba have contractors who may come to your home or the local dump to recover the ODS in a unit. You should contact your local waste disposal ground or municipal office to see if they have such an arrangement.

In Winnipeg, certain scrap yards and appliance dealers will recover the ODS and in some cases pick it up too (check the classified ads). In addition, the City of Winnipeg may be contacted to pick-up a "white good" (appliance). For details, call 311.

Manitoba Hydro has been hosting a Retire Your Fridge Program. See:

www.hydro.mb.ca/your_home/appliances_electronics/retire_fridge.shtml



What role does Environment & Climate Change Canada play regarding ODSs?

Environment & Climate Change Canada enforces regulations dealing with the import, export, manufacture, use and sale of various ODSs. For example, only authorized importers can bring regulated ODSs into Canada. Export permits are also required. Sale, importation and manufacture of most aerosol containers (10 kilograms or less of CFCs) is also prohibited. There are also restrictions on ODSs in food and beverage containers. Environment Canada also works with other provinces, including MOPIA, to facilitate compliance with the Montreal Protocol. They publish various statistical data, codes of practice and monitor ozone levels in the atmosphere.

Where can I get additional labels, regulations, compliance guides, etc?

Many of these items are available electronically on our website, www.mopia.ca

If I'm working on a unit, can my apprentice or assistant hook up gauges, recover and / or replace ODS gas?

Absolutely not, unless the person has an valid Manitoba ODS certification card issued through [MOPIA](http://www.mopia.ca).



Do facilities exist to destroy ODSs?

Facilities in the USA exist to handle contaminated and recovered ODSs. As well, there is a potential site in Alberta (Swan Hills). ODSs are permanently destroyed by high temperature combustion (incineration).

Refrigerant Management Canada supports the disposal of surplus and contaminated refrigerants from the stationary air conditioning and refrigeration sectors. Visit: www.refrigerantmanagement.ca

What are other provinces doing about ODSs?

In Canada, all provinces have ODS legislation in the form of regulations. In general, they are all quite similar but do differ on certain specific issues. If you are planning to work in another province, contact their respective provincial Department of Environment for information on their ODS regulations. You will likely have to register or obtain your HRAI wall certificate interprovincial number with their office. Contact [MOPIA](http://www.mopia.ca) for more information on other provincial ODS legislation.

How often & where do I send the record data sheets?

Send them once a year by February 1st to [MOPIA](http://www.mopia.ca), via email, fax or mail.

On every job, you must record the amount of ODS added and other job specific details.

Also, use different sheets for different ODSs. This will allow you to run down or add up the balance. It will also be easier to follow and identify when a tank is full of recovered ODS (if you don't immediately replace recovered ODS into the unit you are working on).

What is the purpose of annual renewal?

Annual renewal was designed to ensure constant contact with those maintaining ODS certification. Also, many individuals come & go in the industry and this will better ensure accuracy of who is working with ODSs at any given time. Other statistical information can be collected through questions on the renewal forms. Note that the renewal is also designed to assist Manitoba Sustainable Development Officers and for statistical data.

What should I do if my card is stolen, lost or misplaced?

Contact **MOPIA** immediately. **MOPIA** may re-issue you a new card & number.

What type of scale must I use?

Any scale that is accurate within 10%. At this time no specific scale has been designated by the regulation. However, federal guidelines are being assessed and will be made known to you.

Are there any standards for reclaim / recovery units?

They must be accurate, fully functional and preferably IULC, CSA or ARI approved.

At this time, standards are being defined by a national working group on recovery systems.

Halons - ULC/ORD - cL058.5-2004

Refrigerants - ARI standard 740-98

see sections 7(2) and 7(3)

Can I purchase a hydrocarbon or other replacement refrigerant over the counter and drop-it-in my A/C system?

Various (unregulated) hydrocarbon and substitute refrigerants are being sold at retail outlets. If they are being sold to the public, they must only be non-regulated (not ODSs) gases, including hydrocarbons and certain other substances. They are sold under the RedTek, Duracool, Repla and several potential other brands. These substances may be purchased by the public without being certified, but - they must not add these substances into an A/C system that contains a regulated substance as this is creating a cocktail or mixture, prohibited by the legislation. In addition, many of these substances may interact poorly or potentially damage the A/C system in this manner as the original equipment may not have been designed to work with the new or alternative substance without further retrofitting or parts or equipment. In all cases, the public should research, consult or have a certified trained technician service the equipment, as they have the training, specialized tools and equipment to properly service systems. Venting any HCFC or HFC to the environment is punishable by penalties under the Act, intentionally or by accident.

Is HFO 1234yf refrigerant compatible with HFC 134a air conditioning systems?

Generally, no. New recovery units and other air conditioning components may be required. Consult the manufacturer before using any new refrigerant, or you risk voiding your warranty or worse, damaging equipment.

Out of Province Sales

An out of province purchaser who is working in Manitoba must be certified. An out of province purchaser outside Manitoba may purchase refrigerant if:

- a. they have certified technicians
- b. conform to Regulation 103/94 responsibilities
- c. have contacted **MOPIA** regarding a secondary distributor permit

Sales of split systems to non-certified persons

The sale of split systems must be to certified technicians and secondary distributors only.

Certification of counter-persons

Counter-persons should receive instruction / education but not certification provided they do not hook up hoses, charge, service or repair units. Technical representatives should be certified as they demonstrate products and techniques.

Certification of students in a classroom

Students in a learning environment (high school) will function under the certification and guidance of the instructor. Students must obtain certification if they are handling regulated products.

Reclaim units purchase inquiries

Recycling units should be CSA approved, ULC approved for purity (Air Conditioning and Refrigeration Industry), ARI-700 standard for purity or the SAE-J1991 standard for purity, ARI-740 standard for performance. Home built recovery units should only be constructed with the approval of the Department of Labour and Immigration.

www.gov.mb.ca/labour

Tag on equipment

A service record of maintenance and repair should be attached to equipment to provide a service history for future technicians as well as the owner.

Discharge of contents from hose: reclaim

The maximum length of hose without shut off valves is to be limited to 36". You may use any length of charging hose as long as you can shut off and isolate the refrigerant in the hose and remove the refrigerant with a recycler or a recovery unit.

Approved Cylinders

Use only approved cylinders – Department of Transportation approved. (Propane tanks are not acceptable.) Cylinders must be colour coded in accordance to WHMIS. They must also be refillable and recyclable. For more:

www.tc.gc.ca/eng/tdg/moc-cylinder-menu-363.html

Appliance sector

The appliance sector may require that only virgin quality refrigerant products are used otherwise the warranty is null and void. All domestic appliance technicians should be aware that this direction is from the appliance manufacturers' associations. (Some service shops have been recycling CFC-12 for years successfully.) The onus and liability for refrigeration system failure will be the responsibility of the service technician.



Beverage producers Coca Cola and Pepsico have committed to eliminating HFC machines globally.

White goods

White goods include such items as the following:

- a) domestic fridges
- b) domestic freezers
- c) window air conditioners
- d) any 115-230 volt self contained plug-in units:
 - i) drinking fountains
 - ii) pneumatic air dryers
 - iii) dehumidifiers (residential)



Weights and measures


Until such time as the Federal Government has adopted scales that meet industry needs, present scale and record keeping requirements (provided they are accurate within 10%) are acceptable for record keeping purposes.



APPENDICES

OZONE IN THE ATMOSPHERE

In the upper atmosphere, a protective layer of ozone (O_3) shields us from the sun's damaging rays, while at ground level this same gas is a serious air pollutant (smog). Most of the ozone in the atmosphere occurs between 15 and 40 km, with the heaviest concentration between 20 and 30 km. Compressed it is only 3mm thick. Ozone depletion is anticipated to be worst around the years 2000 -2005.

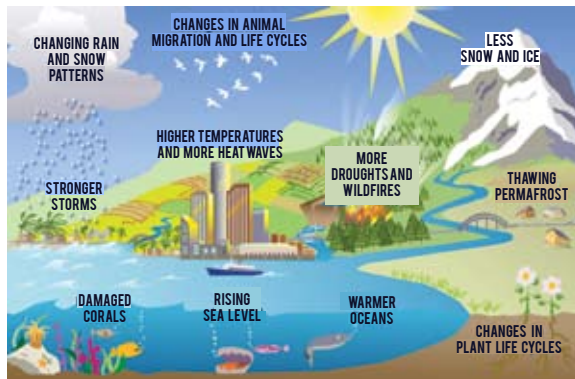

Source: www.nasa.gov/multimedia/imagegallery/itod.html



OZONE DEPLETING POTENTIAL (ODP) & GLOBAL WARMING POTENTIAL (GWP)

Common refrigerants and Ozone Depletion Potential (ODP) and Global Warming Potential (GWP) are indicated below.

- Ozone Depletion Potential (ODP) of a chemical compound is the relative amount of degradation it can cause to the ozone layer
- Global Warming Potential (GWP) is a measure of how much a given mass of a gas contributes to global warming. GWP is a relative scale which compares the amount of heat trapped by greenhouse gas to the amount of heat trapped in the same mass of Carbon Dioxide. The GWP of Carbon Dioxide is by definition 1. Be aware that GWPs are highly controversial.

Refrigerant	Ozone Depletion Potential (ODP)	Global Warming Potential (GWP)
R-11 - Trichlorofluoromethane	1.0	4000
R-12 - Dichlorodifluoromethane	1.0	2400
R-1234yf - Hydrofluoroolefin	0	4
R-13 B1 - Bromotrifluoromethane	10	0
R-22 - Chlorodifluoromethane	0.05	1700
R-32 - Difluoromethane	0	650
R-113 - Trichlorotrifluoroethane	0.8	4800
R-114 - Dichlorotetrafluoroethane	1.0	3.9
R-123 - Dichlorotrifluoroethane	0.02	0.02
R-124 - Chlorotetrafluoroethane	0.02	620
R-125 - Pentafluoroethane	0	3400
R-134a - Tetrafluoroethane	0	1300
R-143a - Trifluoroethane	0	4300
R-152a - Difluoroethane	0	120
R-245a - Pentafluoropropane	0	0
R-401A (53% R-22, 34% R-124, 13% R-152a)	0.37	1100
R-401B (61% R-22, 28% R-124, 11% R-152a)	0.04	1200
R-402A (38% R-22, 60% R-125, 2% R-290)	0.02	2600
R-404A (44% R-125, 52% R-143a, R-134a)	0	3300
R-407A (20% R-32, 40% R-125, 40% R-134a)	0	2000
R-407C (23% R-32, 25% R-125, 52% R-134a)	0	1600
R-502 (48.8% R-22, 51.2% R-115)	0.283	4.1
R-507 (45% R-125, 55% R-143)	0	3300
R-717 Ammonia - NH3	0	0
R-718 Water - H2O	0	0
R-729 Air	0	0
R-744 Carbon Dioxide - CO2	0	1*

* CO2 is the GWP reference

EXAMPLES OF PRODUCTS POTENTIALLY CONTAINING OR USING CFCs, HCFCs, OR HFCs

RIGID FOAM

- automotive door panel padding
- buoy, dock protection foam padding
- crack or crevice filler
- foam packing cushion chips
- foundation/basement
- insulating sheets
- freezer insulation
- refrigerator insulation
- rigid pipe insulation
- storage tank insulation
- styrofoam
- supermarket meat trays

MISCELLANEOUS

- aerosol cleaners where exempted
- aircraft fire extinguisher systems
- bronchial inhalant medications
- chewing gum remover
- computer room fire extinguishers
- hemorrhoidal foam
- hospital sterilization
- marine horns and sirens
- skin sterilant used prior to surgery

REFRIGERATION & AIR CONDITIONING

- agricultural food chiller
- aircraft air conditioning
- auto air conditioners
- dehumidifiers
- commercial fishing boat refrigeration
- home air conditioners, central & window units
- home refrigerators
- office building chillers
- process industry refrigeration, heat recovery
- refrigerated transport trucks, rail cars
- rooftop and office building air conditioner
- soda fountain dispenser
- vending machines

ELECTRONICS, CLEANING AGENTS

- ball bearings
- chemical warfare decontamination fluids
- coolant systems for infrared sensing missiles
- radioactive decontamination

CANADIAN PHASE-OUT

Canadian position on phase-out of production and consumption of ozone-depleting substances

HALONS:

- 100% elimination by January 1, 1994*

CARBON TETRACHLORIDE:

- 100% elimination by January 1, 1995*

CFCs:

- 100% elimination by January 1, 1996*

METHYL CHLOROFORM:

- 100% elimination by January 1, 1996*

HCFCs:**

HCFCs are a controlled substance under the Canadian Environmental Protection Act, 1999, and its Ozone-depleting Substances Regulations, 1998, because of their ozone-depleting potential. Importation and manufacturing of new or "virgin" HCFCs is regulated by a federal allowance system. The Canadian government has adopted the following phase-out schedule for HCFCs based on the terms of the Montreal Protocol:

Jan. 1, 2010:

No new R-22 equipment manufactured or imported

Jan. 1, 2015:

Annual allowable amount of HCFCs reduced by 90%

Jan. 1, 2020:

Annual allowable amount of HCFCs reduced by 99.5% except HCFC-123, which can be imported or manufactured until 2030 to service large air conditioning units (chillers) under the remaining .5% allowance. No new HCFC equipment to be manufactured or imported.

Jan. 1, 2030:

HCFCs no longer permitted to be imported or manufactured.

HFCs:

With the international adoption of the Kigali Agreement (2016) on HFCs, Canada is consulting with stakeholders and is expected to implement a phase-down / phase-out timetable for the manufacture, import and possible use restrictions on HFCs shortly.

HBFCs:

100% elimination by January 1, 1996*

METHYL BROMIDE:

- Freeze beginning January 1, 1995 at 1991 levels (Except quarantine and pre-shipment applications)
- * The Parties agreed on a provision for possible exemptions to the phase-out dates for "essential uses", to be determined by the UNEP Technology and Economic Assessment panel according to essential use criteria adopted by the Parties. Canada will consider such exemptions on a case by case basis.

** Controls on HCFCs relate to consumption only, not production. Controls for all other substances relate to production and consumption (consumption = production + imports - exports).

For current Canadian ODS phase-out information, see: www.ec.gc.ca/ozone

FEDERAL HALOCARBON REGULATIONS

Federal facilities and undertakings are governed by Canada's Halocarbon Regulations, under the authority of the *Canadian Environmental Protection Act*. **MOPIA** recommends you consult these regulations specifically, as they are federal, not provincial in scope.

Visit: www.ec.gc.ca/lcpe-cepa/eng/regulations

Pressure Temperature Charts are available at: www.chemours.com/Refrigerants/en_US/uses_apps/PT_Calculator_app.html or search on the web pressure temperature refrigerant charts.

THERMOSTAT MERCURY RECOVERY PROGRAM




Switch the 'Stat is a thermostat collection program, first launched in 2016. Thermostats contain approximately 2.5-10 grams of mercury, and so the safe collection and disposal of mercury is critical, keeping it from the landfills and water tables of Manitoba communities.

HRAI Canada administers the program, and **MOPIA** is one of the program's depots.

Visit: www.switchthestat.ca/en/index.php

CLIMATE CHANGE DYNAMICS

Global warming / climate change is caused by the accumulation of certain gases in the atmosphere due to human activities. These gases prevent the sun's rays from escaping the earth's atmosphere after having bounced off the earth's surface. The gases which are thought to be contributing to the greenhouse effect are carbon dioxide, nitrous oxide, methane, CFCs and some of their alternatives (such as HFCs). The impacts of climate change are anticipated to be significant and far reaching.

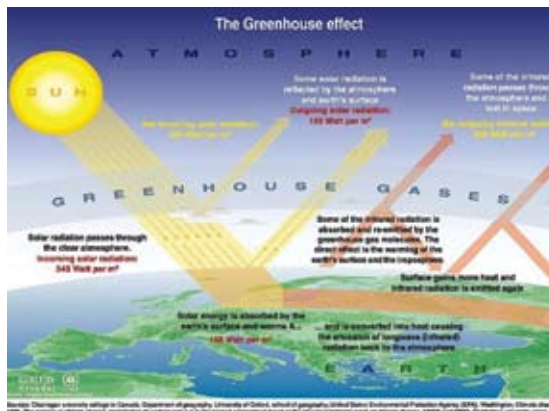

1. Solar energy penetrates the Earth's atmosphere
2. Most of this energy is absorbed by the Earth's surface and re-emitted as infrared radiation.
3. Greenhouse gases absorb and re-emit some of this radiation, warming the Earth's surface and the lower atmosphere.

ODS RECORD DATA SHEET

[illegible]

Every time a regulated refrigerant is recovered or added (charged/recharged) into a A/C or refrigeration system, the type of refrigerant, quantity, and related info must be recorded and also submitted (once per year) by February 1 to **MOPIA** including the service technician's certification number and name. If you did not use any regulated substance during a given year, you must still report to **MOPIA** your "no use" status.

REFRIGERANT STEWARDSHIP

Refrigerant Management Canada (RMC) is a not-for-profit corporation administered by the Heating, Refrigeration and Air Conditioning Institute of Canada (HRAI) and the Canadian refrigeration and air conditioning industry. The program is an industry-led environmental care program committed to the responsible disposal of surplus ozone depleting refrigerants such as CFCs and HFCs from the stationary refrigeration and air conditioning industry sectors. Visit: www.refrigerantmanagement.ca

OZONE & CLIMATE FACT

Chlorine is considered a major factor in stratospheric ozone depletion. However, chlorine from swimming pools, household bleach and sea salt (sodium chloride) does not contribute to ozone destruction due to the fact that they are water soluble and reactive.

Therefore, these chemicals are removed from the lower atmosphere, never reaching the stratosphere in significant amounts. However, human-made halocarbons, such as CFCs, are able to migrate to the stratosphere because they are extremely stable compounds and once up there they have the potential to destroy thousands of ozone molecules.

Visit: www.ozone.noaa.gov/science/basics.htm



Bob Stark (4th Chair of **MOPIA**, 1998) and Mark Miller at the **MOPIA** Program Awareness Session in Winkler, June 2017.

APPROVED LEAK TESTING

You must eliminate the venting of any regulated refrigerant or replacement gas, it is mandatory to leak test by not adding any ODS. Where possible, use nitrogen and/or soap & water, as the known industry standards. Other methods are acceptable (see below).

Please note that is also good practice to recover non-ODS refrigerants. Some of these substances are potentially harmful as heat trapping greenhouse gases and/or may be harmful to human health. Separate recovery units are required to contain the various refrigerants. Cross contamination of refrigerant gases may cause air conditioning equipment damage if replaced in a unit and is contrary to the Regulation. In addition, contamination of an ODS is prohibited in the Regulation.

Approved leak testing methods

Under ***The Manitoba Ozone Depleting Substances and Other Halocarbons Regulation*** (Section 12), no person shall recharge or top-up equipment that contains an ozone depleting substance (ODS) unless the person first conducts a leak test and repairs the identified leak permanently. Technicians may choose one or more of the following leak test methods to ensure a units system is/will work effectively after any ODS is added following the system's repair. The following is the prescribed leak test procedure and list of acceptable leak testing methods recognized by Manitoba Sustainable Development. They are subject to change.

Prescribed leak test procedures

1. If the system still contains an ozone depleting substance (ODS), proceed to item #3.
- 2- If the system has lost its charge and no longer contains an ODS, it must first be pressurized to a minimum of 150 psi (1034 kPa) or such a pressure as not to rupture the system using dry nitrogen.
- 3 Use one of the appropriate method(s) indicated under "Acceptable Leak Testing Methods" to detect the presence and location of a leak.
- 4 If no leak is detected after fully and thoroughly leak checking, you may recharge the system
5. If a leak is found, isolate that component if possible. Recover any ODS from the component or system.
6. Once any remaining ODS has been recovered, repair or replace the component or system.
7. Perform another leak test method to confirm that the leak has been repaired. If any leaks are found, repeat items #1-7 until all leaks have been repaired.
8. Evacuate the system in accordance with the manufacturers recommended evacuation/ dehydration levels. When the manufacturers information is unavailable evacuate to 29.87 in Hg. (500 microns) and hold for a minimum of 10 minutes (as described in the "Acceptable Leak Testing Methods" Standing Vacuum Test).
9. The system has now been evacuated and dehydrated. The system must now be recharged using the same ODS or replacement refrigerant in accordance with the Manufacturers Certified Installation, Specifications and Service Manuals

and the Code of Practice for the Reduction of Chlorofluorocarbon Emissions from Refrigeration and Air Conditioning Systems (published by Environment and Climate Change Canada). These items are subject to the Minister's approval and amending and updating.

An ozone depleting substance must not be added to nitrogen or dry air for use as a trace gas. However, you may use the remaining (remnant) ODS gas that was in the system to immediately check for leaks.

Acceptable leak testing methods

There are many different techniques for leak testing, with varying degrees of accuracy depending on the system being tested. The following guidelines are acceptable procedure for leak testing of various stationary refrigeration and air conditioning systems.

The following techniques have been identified by **MOPIA** and are acceptable by Manitoba Sustainable Development. The most appropriate leak test method for the circumstance should be chosen and performed by an ozone depleting substances certified individual ("trained service technician"). The completion of a leak test is not a guarantee against leaks in the future, and therefore is not meant to replace an existing preventative maintenance program.

1. Electronic leak detection
- 2- Halide flame leak detection
3. Soap and bubble test
4. Ultrasonic leak detection
5. Fluorescent dye leak detection
6. Standing vacuum test
7. Standing nitrogen pressure test

Please note: Any additional leak testing technologies that are developed and find acceptance within the refrigeration and air conditioning industry may become acceptable and added to these guidelines. They must first be approved under M.R. 103/94. It is recommended that you periodically check with **MOPIA** for the latest list of acceptable leak test procedures.

AUTO OZONE FACT

Automotive air conditioners (refrigerants) account for the largest single source of atmosphere damaging emissions. This is estimated at 25% of all ODSs. That's why your cooperation is important and required to either repair leaks in a permanent manner or retrofit.

For more information: visit

www.mmmba.mb.ca

www.mucda.mb.ca

www.macsww.org

www.atamb.ca



CERTIFICATION TRAINING

MOPIA continues to host one-day technician certification classes for those who plan to handle regulated products. Also, certain industry sectors do not have training available at all times such as those in the white goods (appliance) and some automotive, trucking, and other A/C sectors. Since 1993, some 14,000 people have been trained and certified in Manitoba.

MOPIA's one-day certification training focuses on environmental and regulation awareness education, and is not a replacement for any trades or industry hands-on equipment training. Training classes are hosted on an "as needed" basis upon application of enough participants and held throughout Manitoba where need is demonstrated. **MOPIA** is also investigating on-line delivery of the program at some future point for the convenience of our stakeholders particularly outside of the Winnipeg geographic region. Training dates and costs are available on **MOPIA's** website.



*Students being taught by Mr. Botho Kramer, one of **MOPIA's** certification trainers who was a Red River College HVAC/R instructor for over 30 years.*



Refrigeration Service Engineers Society (RSES) Manitoba Chapter hosting an Industry Educational Session in Manitoba.

The picture above was taken at Red River College (February 2014) with instructor George Kurowski and D. Brian Baker hosting this RSES event.



This is a HFO 1234yf refrigerant cylinder, first seen in Manitoba in 2013. They are half the size of a typical ODS cylinder, as its introductory price is substantially higher than many HFCs.



John Kubilanski (MOPIA Chair 2015-2017) in Dubai, UAE at the 27th Meeting of the Parties to the Montreal Protocol (27th MOP)

INDUSTRY AND PUBLIC OUTREACH

MOPIA has conducted a number of outreach programs to alert the industry and public on issues specific to **MOPIA's** mandate on Ozone Depleting and Climate Change Substances.



IT'S ILLEGAL TO "TOP UP" AIR CONDITIONING SYSTEMS

Air conditioning refrigerant leaks (whether in vehicles, ag equipment, home or building systems) are potentially harmful to the equipment and damaging to the environment if left leaking. If a system is not cooling well or "low on refrigerant", there's possibly a refrigerant line leak. A certified trained service professional can diagnose and leak test according to standards and make a permanent repair to the unit.

It is against the law to "Top Up" refrigerant (just adding more refrigerant to a system). Under Manitoba law, refrigerant systems must be "leak tested" and permanently repaired. Manitoba Certified Refrigerant Service Technicians are trained to capture your remaining refrigerant, to perform the leak test, and repair all leak sources BEFORE recharging your system. It's their responsibility to record the results of your leak test, and to ensure it is repaired, under provincial law.

Wrongful servicing can lead to penalties of up to \$1,000,000 for companies and fines of \$100,000 for persons and imprisonment.

Repairing your air conditioning system properly is not only a good idea, IT'S THE LAW...

To learn more about acceptable leak testing procedures, visit www.mopla.ca/outreach/leak-testing

Any suspicious air conditioning service practices should be reported to an Environment Officer at 204-945-7100.

For the full regulations, visit: www.mb.ca/conservation/pollutionprevention/ods

This poster courtesy of



MOPIA
1-888-667-4203
204-338-2222
www.mopla.ca
mopla@mts.net



AIR CONDITIONING SERVICE Do's & Don'ts

DO'S
Any time there is a refrigerant leak, a thorough leak test must be performed to determine where the actual leak is located. Once this is determined, the leak can be permanently repaired. Just adding refrigerant to a system is not permitted as this does not fix the problem, and may lead to long term equipment failure and harm to the environment.

Certified technicians can use refrigerants existing in system while performing leak test, but cannot add refrigerants to leak test. If no leak is found using an approved leak test protocol, refrigerant may be added.

If a leak is found, the technician must tell YOU, the customer. The owner of the vehicle or equipment is then obligated to get the leak repaired as soon as possible, as this will minimize potential damage to the equipment and the environment.

DON'TS

The following practices are not permitted:

- Just "topping up" a leaking system
- The discharge of a regulated refrigerant (i.e. HCFC, HFC) into the environment is illegal
- Continuing to run without repairing the leak. Owners should be advised by the mechanic of the environmental impact of their leak, and know that they can damage their A/C unit by running it without a proper charge of refrigerant
- Adding a different refrigerant than the one already in the system, which can cause a potentially dangerous "chemical cocktail", which can also damage your system
- Adding refrigerants other than the factory-mandated ones into your A/C system

Leak testing methods are specific, as prescribed by The Code of Practice (Environment Canada) and MOPIA. For details, visit www.mopla.ca or <http://ec.gc.ca/ozone/default.asp?lang=En&n=E06A6800-1>

MOPIA has issued several purchasing bulletins, including this one which highlights who may purchase regulated refrigerants and parts. Visit our website or contact **MOPIA** if you would like a copy to post.



Purchasing Bulletin Manitoba ODS Regulation Compliance Air Conditioning & Refrigeration Sectors Environmental Protection May 2018



Who can purchase Refrigerant (CFCs, HCFCs, HFCs) and A/C Equipment & Parts?

Under the Manitoba Ozone Depleting Substances and Other Halocarbons Regulation, only companies who have a **Secondary Distributor permit** and/or individuals who are recognized as **Manitoba ODS Certified Technicians** may acquire, purchase or import regulated product(s) into (or within) Manitoba.

Regulated products include nearly all refrigerants (including CFCs, HCFCs & HFCs) and any new or used equipment or component that makes up or is attached to a closed refrigerant loop.

It is a violation of the Regulation to sell any regulated product to a person or company who does not have a SD permit number or to a person who is not Minister of Sustainable Development (MOPIA) certified in the Province of Manitoba (or outside Manitoba where an HRAI certification number is recognized). As a seller of product, you are responsible to verify and document the permit or certification number. Significant penalties exist under the Ozone Depleting Substances Act CDSM 080 for those who contravene this regulatory compliance responsibility - see it online at: https://web2.gov.mb.ca/laws/reg/current/_pdf/reg.php?reg=103/94

There are two options to acquire/purchase...	
<p>Secondary Distributor Permit</p> <p>Annual Permit Effective January 1-December 31 each year \$50.00</p> <p>Technician Certification</p> <p>Annual Certification Renewable June 1 each year \$25.00</p>	<p>SECONDARY DISTRIBUTOR PERMIT 2018</p> <p>A Secondary Distributor (SD) Permit is required in the Province of Manitoba for those companies which purchase regulated (new or used) air conditioning equipment or parts and/or substances (refrigerants), as defined under the Manitoba ODS and Other Halocarbons Regulation. The SD Permit is intended for air conditioning and refrigeration wholesalers, distributors, agriculture, auto and truck dealerships, service centres, body shops, other air conditioning related mechanical contractors, etc.</p> <p>An ODS Technician Certification wallet card with an assigned 4 or 5 digit number is issued annually to every person recognized by (MOPIA) and the Minister of Sustainable Development. These persons may purchase regulated products. Ask to see their card! You'll need to record their certification number on the purchase of regulated product(s). If in doubt, contact MOPIA for verification. The certification is not transferable.</p>

- A SD Permit and/or certification is not required for purchasing White Goods (i.e. fridges, freezers).
- Secondary Distributors are reminded that as per Manitoba Regulation R234, all transactions of regulated products must be recorded and made available to an Environment Officer upon request.

For more info, please visit: www.mopla.ca or call (204.338.2222) or 1.888.667.4203
1082 Main Street, Winnipeg, Manitoba, Canada R2W 5J3



Topping-up A/C systems of any kind with a regulated refrigerant is prohibited. A complete leak test must be performed to permanently repair a leak before additional gas is added.

Adding a hydrocarbon or other substitute refrigerant into a system that contains a different regulated refrigerant is also prohibited and may cause system / equipment damage.

REGULATED PRODUCTS

One additional purchasing bulletin issued by **MOPIA** highlighting what is regulated and restricted to certified persons and Secondary Distributor Permit holders.

Persons need certification to access regulated refrigerants and parts/equipment. Wholesalers and distributors face major penalties if they sell to persons not carrying the proper and valid certification.

Regulated Products Bulletin MR 103/94




Regulated Refrigerants include CFC's, HCFC's and HFC's

The Manitoba Ozone Depleting Substances and Other Halocarbons Regulation 103/94 lists all regulated refrigerants. They include: R-134a, R-123, R-22, R-410, R-404, R-507, blends and many, many more...

* Hydrocarbons (propane/butane type products) are not regulated under this Regulation but must not be added directly to a unit that has a regulated refrigerant (coolants are illegal).

Note: Refrigerant containers **must be refillable** (often have a core charge) and meet Transport Canada (i.e. within hydrostatic test date) and Environment Canada specifications. For more details visit:

www.tc.gc.ca/eng/hdg/mcc-cylinder-faq-qns/index-473.html



Refillable cylinder valve
Legal




Non-refillable Valve
Not Legal

Any and All Parts (new or used) Connected to the Closed Refrigerant Loop are also Regulated*

(*meaning the purchase and servicing is restricted)

These include items such as:

- Compressors
- Hoses
- Lines
- Roof-Top Units
- And many more...
- Split Systems
- Evaporators
- Condensers
- Filter Dryers



Regulated

Who can purchase Regulated Refrigerant(s) and A/C Equipment & Parts?

Under the Manitoba Ozone Depleting Substances and Other Halocarbons Regulation 103/94, only companies who have a **Secondary Distributor permit** and/or individuals who are recognized as Manitoba **ODS Certified Technicians** may acquire, purchase or import regulated product(s) into (or within) Manitoba.



It is a violation to sell any regulated product to a person or company who does not have a **SD permit number** or to a person who is not Minister of Conservation (MOPIA) certified in the Province of Manitoba. If you are a seller of regulated product, you are responsible to verify and document the SD permit or certification number. **Significant penalties exist** for those who contravene this regulatory compliance responsibility! These include fines up to \$100,000 for persons, plus jail time and up to \$1 million for corporations and restitution, compensation and other fines as the judge warrants. Compliance enforcement does happen across Manitoba.

See: www.gov.mb.ca/conservation/pollutionprevention/ods/index.html

For more info, please visit: www.mopiac.ca or call (204.338.2222) or 1.888.667.4203
1082 Main Street, Winnipeg, Manitoba, Canada R2W 5A3



SHOW IT SEE IT

IT'S THE LAW!

This wallet size card is mandatory for all persons servicing or purchasing regulated refrigerant(s), part(s) and equipment.

The card is issued annually and is needed when purchasing refrigerant or parts on the gas side of new or used refrigeration or air conditioning systems.

Companies with a valid Secondary Distributor (SD) Permit may also purchase regulated products.

No company S.D. Permit? No card? NO SALE!

No Certification Card or Secondary Distributor Permit means - No Sale!
Cards and Permits are not transferable.

Tough Penalties

Penalties exist for anyone purchasing and/or selling regulated products without a valid Certification Card. You may verify a card's validity by contacting MOPIA.

Wholesalers & Distributors

Anyone selling regulated new or used air conditioning and refrigeration equipment, parts and/or refrigerant are obligated to see and record a MB-number off a valid Certification Card.



MOPIA
1082 Main Street
Winnipeg, Manitoba, Canada
1.888.667.4203 Toll Free
204.338.2222 in Winnipeg
www.mopiac.ca

MOPIA'S ADMINISTRATION TEAM

Executive Director:

Mark Miller

Email: mm@mopia.ca

Executive Assistant:

Laura Bjornson

Email: laura@mopia.ca

Administrative Assistants:

Jocelyn Silva

Nina Le

Email: info@mopia.ca



Laura Bjornson



Jocelyn Silva



Nina Le

Our staff are dedicated to providing exceptional customer service, always.

WWW.MOPIA.CA • FAX 204.338.0810

MOPIA issued this consumer awareness bulletin (July 2013) to inform the public that topping-up A/C may pose negative circumstances and is illegal if a different refrigerant mixes with a class 1, 2 or 3 refrigerant. **MOPIA** hopes to generate media interest in protecting consumers from misinformation and improper A/C servicing.



RECHARGING YOUR AIR CONDITIONING?

DON'T D.I.Y.

DO IT RIGHT

Under Manitoba Law, this improper handling of refrigerant is a criminal offence. Anyone who knowingly or recklessly violates this law is liable to a fine of up to \$5,000 and/or a term of imprisonment or both.

DO IT RIGHT

Four types of automobile air conditioning units (and refrigerants and hoses) are equipped with refrigerants that are available to consumers at retail outlets. When you buy containers of "top up" refrigerant, complete with "do it yourself" connectors, you're taking significant risks:

- ⚠️ **MIXING REFRIGERANTS MAY DAMAGE YOUR EQUIPMENT**
Many years' history related engine and system wear, possibly cause damage to the compressor and/or your air conditioning. This will certainly pose safety risks to your car.
- ⚠️ **MIXING REFRIGERANTS IS BOTH DANGEROUS AND ILLEGAL**
Each refrigerant has its own properties. Mixing dissimilar refrigerants can cause chemical reactions, pressure increases, and is illegal in Canada. Only trained and certified technicians are legally allowed to perform refrigerant handling.
- ⚠️ **THE ILLEGAL RELEASE OF REFRIGERANTS IS HARMFUL TO THE ENVIRONMENT**
Most refrigerants have significant global warming potential. Some refrigerants, such as propane and ammonia, are potentially harmful to back in humans.



CERTIFIED A/C TECHNICIANS FOLLOW THE THREE R's OF REFRIGERANT HANDLING

If you're low on refrigerant, you already have a leak in your air conditioning system. Instead of just "topping up", you need a certified technician to do this job.

- ✓ **RECOVER** - recovering refrigerant and seal the leaks
- ✓ **REPAIR LEAKS** - permanent repairs, not temporary sealant
- ✓ **RECHARGE** - your system with proper refrigerant

Certified A/C Technicians have the right technology to perform these tasks, and recharge your system with the right refrigerant.

DON'T D.I.Y.

DO IT RIGHT

Visit mopia.ca/issues/doitright to learn more.

MANITOBA OZONE PROTECTION INDUSTRY ASSOCIATION

1022 Main Street, Winnipeg, Manitoba, Canada R2M 3J3
 Phone: 204.338.0810 • Text: 514 • 1.888.4.MOPIA.4303
 Fax: 204.338.0800



Environmental Resources / Links

There are a number of environmental organizations in Manitoba that are interested in atmosphere protection. They may also have literature or research information on ozone depleting substances published in-house or by various national or international organizations.

The Manitoba Eco-Network is the umbrella organization for most of Manitoba's environmental groups. If you require information on specific topics or need to contact other provincial groups, they are your best source for information.

www.mbeconetwork.org

Climate Change Connection:

www.climatechangeconnection.org

The Heating, Refrigerating and Air Conditioning Institute of Canada (HRAI)

www.hrai.ca

Canadian Cancer Society

www.cancer.ca/en.about-us/for-media/media-releases/manitoba/?region=mb

Manitoba Environmental Industries Assoc. (MEIA)

www.meia.mb.ca

International Institute of Refrigeration

www.iifiir.org



MOPIA hosted international study tours to Manitoba showcasing our innovative program approach to the world. Pictured here are representatives from UNEP, Uruguay, Burkino Faso & Bahrain

PROVINCIAL ENVIRONMENT OFFICERS CONTACT INFORMATION

Contact a Manitoba Sustainable Development Enforcement and Regional Compliance office nearest you:

www.gov.mb.ca/sd/ece/contact.html

Manitoba Sustainable Development

204.945.7100

ods@gov.mb.ca

www.gov.mb.ca

Leak Report Line

Fax leak report form to: 204.948.2338

Tip Line

To report individuals / companies out of compliance, contact your Regional Enforcement and Compliance office, as seen below.

**Environmental Compliance and Enforcement
Contact Information**

Northeast Region	Thompson	204.677.6703
Northwest Region	The Pas	204.627.8499
Western Region	Brandon	204.726.6565
Western Region	Dauphin	204.622.2030
Central Region	Portage	204.239.3608
Central Region	Winnipeg	204.945.5305
Central Region	Selkirk	204.785.5030
Eastern Region	Lac du Bonnet	204.345.1486

Consumer Protection Office

204.945.3800

800.782.0067 toll-free

www.gov.mb.ca/cc/cpo/

KILGALI AGREEMENT - HFC PHASEOUT

Parties to The Montreal Protocol agreed to Amend the Protocol at their 28th Meeting in Rwanda (2016).

The Kigali Agreement is expected to reduce the manufacture and use of HFCs by up to 85% from their respective baselines by 2045. This reduction is expected to mitigate global temperature rise by 0.5 Celsius by 2100.

There is a global thrust to control HFCs, given their high global warming potential (GWP). Canada, along with many other nations, are taking a leadership role to control and reduce the reliance on HFCs. Environment and Climate Change Canada is proposing to regulate HFCs in Canada in various ODS sectors as soon as 2018. These will be potentially controlled under CEPA. Please refer to the actual text for more information.

For details visit <http://ozone.unep.org/en/meetings>



USA EPA SNAP PROGRAM INFORMATION

In the USA, the Environmental Protection Agency administers a program called the Significant New Alternatives Program (SNAP). Certain non-ODS substances are restricted from use. For instance certain hydrocarbon refrigerants may be vented, with precautions and never when cocktailed with regulated refrigerants.

See details at: www.epa.gov/ozone/snap/index.html

ENFORCEMENT & PENALTIES

Non compliance under provincial and federal regulations controlling refrigerants and ODSs are liable for penalties, fines and possible prison sentencing.

See details at:

www.ec.gc.ca/alef-ewe/default.asp?lang=En&n=8F711F37-1

<http://web2.gov.mb.ca/laws/statutes/ccsm/o080e.php>



STAY INFORMED WITH MOPIA'S MONTHLY BULLETIN



Be Part of MOPIA Website Director Profile & Sign

Hear the Latest & Share Concerns MOPIA Program Update Session

PUT YOURSELF ON THE MAP

Meet MOPIA's Office Team

Recycle Me

MOPIA is a non-profit organization that provides information and resources to help Manitobans protect the environment. We are currently looking for people to help us with our website and social media. If you are interested, please contact us at info@mopia.ca.

The latest update session will be held on June 28th at 10:00 AM. We will be discussing the latest news and updates from the MOPIA program. Please bring a copy of the bulletin with you.

MOPIA's website is a valuable resource for Manitobans. We are looking for people to help us with our website and social media. If you are interested, please contact us at info@mopia.ca.

MOPIA's office team consists of several people who are responsible for different aspects of the program. We are looking for people to help us with our website and social media. If you are interested, please contact us at info@mopia.ca.

MOPIA's 'Recycle Me' program is a valuable resource for Manitobans. We are looking for people to help us with our website and social media. If you are interested, please contact us at info@mopia.ca.

International Day for the Preservation of the Ozone Layer

Be Guarded Against Too Good to be True Deals

Final Summary Certification Class

The United Nations has designated September 16th as International Day for the Preservation of the Ozone Layer. This year, the theme is 'Protecting the Ozone Layer for a Sustainable Future'. MOPIA is holding a series of events to celebrate this day and raise awareness about the importance of protecting the ozone layer.


MOPIA has been selected to host a series of events to celebrate this day. We will be holding a series of events to celebrate this day and raise awareness about the importance of protecting the ozone layer. Please contact us at info@mopia.ca for more information.

MOPIA is holding a series of events to celebrate this day. We will be holding a series of events to celebrate this day and raise awareness about the importance of protecting the ozone layer. Please contact us at info@mopia.ca for more information.

MOPIA is holding a series of events to celebrate this day. We will be holding a series of events to celebrate this day and raise awareness about the importance of protecting the ozone layer. Please contact us at info@mopia.ca for more information.

ISSUED THE
SECOND THURSDAY
OF EACH MONTH

SEND US YOUR EMAIL TO GET IT IN YOUR INBOX
OR VISIT WWW.MOPIA.CA TO SEE THE LATEST ISSUE

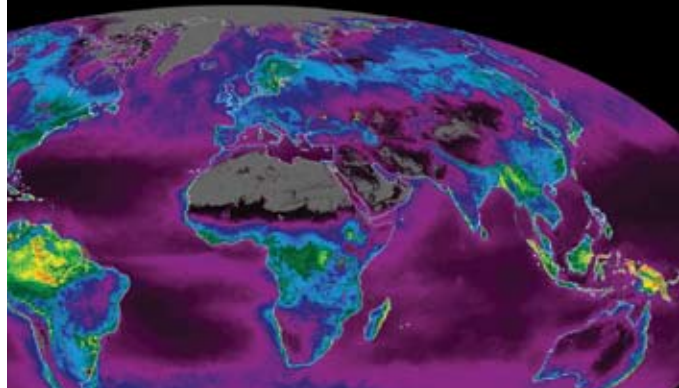

BE PART OF THE SOLUTION!



MOPIA is building a service provider directory, to provide the general public with access to a list of certified service providers, as well as information on the importance of proper ODS handling.

You can register your company at
www.mopia.ca/directorysignup



MOPIA

Winnipeg, Manitoba, Canada

Phone: 204.338.2222

Toll-free 1.888.667.4203

Fax: 204.338.0810

mopia@mopia.ca • www.mopia.ca



PROUDLY PRINTED IN MANITOBA ON
100% POST-CONSUMER PAPER WITH VEGETABLE BASED INKS